

LMP 110-120 series

MULTIPORT

Maximum pressure up to 80 bar - Flow rate up to 200 l/min



FILTER SIZING

Corrective factor

The correct filter sizing have to be based on the variable pressure drop depending by the application. For example, for the return filter the pressure drop have to be in the range 0.4 - 0.6 bar.

The pressure drop calculation is performed by adding together the value of the housing with the value of the filter element. The pressure drop in the housing is proportional to the fluid density (kg/dm^3); all the graphs in the catalogue are referred to mineral oil with density of $0.86 \text{ kg}/\text{dm}^3$.

The filter element pressure drop is proportional to its viscosity (mm^2/s), the corrective factor Y is related to an oil viscosity different than $30 \text{ mm}^2/\text{s}$.

Sizing data for single cartridge, head at top

Δp_c = Filter housing pressure drop [bar]

Δp_e = Filter element pressure drop [bar]

Y = Multiplication factor Y (see correspondent table), depending on the filter element size, on the filter element lenght and on the filter media

Q = flow rate (l/min)

V1 reference viscosity = $30 \text{ mm}^2/\text{s}$ (cSt)

V2 = operating viscosity in mm^2/s (cSt)

$\Delta p_e = Y : 1000 \times Q \times (V2/V1)$

$\Delta p_{\text{Tot.}} = \Delta p_c + \Delta p_e$

Calculation examples with HLP Mineral oil Variation in viscosity

Application data:

Top tank return filter

Filter with in-line connections

Pressure $P_{\text{max}} = 10 \text{ bar}$

Flow rate $Q = 120 \text{ l}/\text{min}$

Viscosity $V_2 = 46 \text{ mm}^2/\text{s}$ (cSt)

Oil viscosity = $0.86 \text{ kg}/\text{dm}^3$

Required filtration efficiency = $25 \mu\text{m}$ with absolute filtration

With bypass valve and $1 \frac{1}{4}$ " inlet connection

From the working pressure and the flow rate we understand it should be possible using the following top tank return filter series: MPT, MPH and FRI. Let's proceed with MPT series.


The size 20 doesn't achieve the required flow rate, therefore we have to consider the size 100. The final version of size 100 (101, 104, 110, 120 and 114) will be then defined in function of the mounting characteristics.

$\Delta p_c = 0.03 \text{ bar}$ (★ see graphic below, considering size 100 with the max available lenght to get the lowest pressure drop)

$\Delta p_e = (2.0 : 1000) \times 120 \times (46/30) = 0.37 \text{ bar}$

$\Delta p_{\text{Tot.}} = 0.03 + 0.37 = 0.4 \text{ bar}$

The selection is correct because the total pressure drop value is inside the admissible range for top tank return filters. It is of course possible trying to find a different solution, according to the mounting position or to other commercial need, repeating the previous steps while using a different series or lenght.

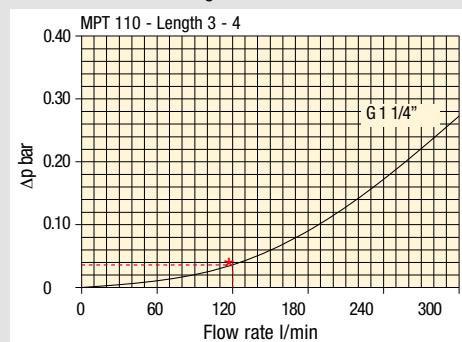

Filter housings Δp pressure drop.

The curves are plotted using mineral oil with density of $0.86 \text{ kg}/\text{dm}^3$ in compliance with ISO 3968. Δp varies proportionally with density.

Corrective factor Y, to be used for the filter element pressure drop calculation.

The values depend to the filter size and lenght and to the filter media.

Reference viscosity $30 \text{ mm}^2/\text{s}$

Return filters

Filter element	Absolute filtration H Series					Nominal filtration N Series			
	Type	A03	A06	A10	A16	A25	P10	P25	M25 M60 M90
MF 020	1	74.00	50.08	20.00	16.00	9.00	6.43	5.51	4.40
	2	29.20	24.12	8.00	7.22	5.00	3.33	2.85	2.00
	3	22.00	19.00	6.56	5.33	4.33	1.68	1.44	1.30
MF 030 MFX 030	1	74.00	50.08	20.00	16.00	9.00	6.43	5.51	3.40
MF 100 MFX 100	1	28.20	24.40	8.67	8.17	6.88	4.62	3.96	1.25
	2	17.33	12.50	6.86	5.70	4.00	3.05	2.47	1.10
	3	10.25	9.00	3.65	3.33	2.50	1.63	1.32	0.96
	4	6.10	5.40	2.30	2.20	2.00	1.19	0.96	0.82
MF 180 MFX 180	1	3.67	3.05	1.64	1.56	1.24	1.18	1.06	0.26
MF 190 MFX 190	2	1.69	1.37	0.68	0.54	0.51	0.43	0.39	0.12
	1	1.69	1.37	0.60	0.49	0.44	0.35	0.31	0.11
MF 400 MFX 400	1	3.20	2.75	1.39	1.33	1.06	0.96	0.87	0.22
	2	2.00	1.87	0.88	0.85	0.55	0.49	0.45	0.13
	3	1.90	1.60	0.63	0.51	0.49	0.39	0.35	0.11
MF 750 MFX 750	1	1.08	0.84	0.49	0.36	0.26	0.21	0.19	0.06
CU 025		78.00	48.00	28.00	24.00	9.33	9.33	8.51	1.25
CU 040		25.88	20.88	10.44	10.00	3.78	3.78	3.30	1.25
CU 100		15.20	14.53	5.14	4.95	2.00	2.00	0.17	1.10
CU 250		3.25	2.55	1.55	1.35	0.71	0.71	0.59	0.25
CU 630		1.96	1.68	0.85	0.72	0.42	0.42	0.36	0.09
CU 850		1.06	0.84	0.42	0.33	0.17	0.17	0.13	0.04
MR 100	1	19.00	17.00	6.90	6.30	4.60	2.94	2.52	1.60
	2	11.70	10.80	4.40	4.30	3.00	2.94	2.52	1.37
	3	7.80	6.87	3.70	3.10	2.70	2.14	1.84	1.34
	4	5.50	4.97	2.60	2.40	2.18	1.72	1.47	1.34
	5	4.20	3.84	2.36	2.15	1.90	1.60	1.37	1.34
MR 250	1	5.35	4.85	2.32	1.92	1.50	1.38	1.20	0.15
	2	4.00	3.28	1.44	1.10	1.07	0.96	0.83	0.13
	3	2.60	2.20	1.08	1.00	0.86	0.77	0.64	0.12
	4	1.84	1.56	0.68	0.56	0.44	0.37	0.23	0.11
MR 630	1	3.10	2.48	1.32	1.14	0.92	0.83	0.73	0.09
	2	2.06	1.92	0.82	0.76	0.38	0.33	0.27	0.08
	3	1.48	1.30	0.60	0.56	0.26	0.22	0.17	0.08
	4	1.30	1.20	0.48	0.40	0.25	0.21	0.16	0.08
	5	0.74	0.65	0.30	0.28	0.13	0.10	0.08	0.04
MR 850	1	0.60	0.43	0.34	0.25	0.13	0.12	0.09	0.03
	2	0.37	0.26	0.23	0.21	0.11	0.08	0.07	0.03
	3	0.27	0.18	0.17	0.17	0.05	0.04	0.04	0.02
	4	0.23	0.16	0.13	0.12	0.04	0.03	0.03	0.02

Corrective factor Y, to be used for the filter element pressure drop calculation.

The values depend to the filter size and lenght and to the filter media.

Reference viscosity 30 mm²/s

Suction filters

Filter element	Nominal filtration N Series	
	P10	P25
SF 250	65	21

Return / Suction filters

Filter element	Absolute filtration		
	A10	A16	A25
RSX 116	1 5.12	4.33	3.85
	2 2.22	1.87	1.22
RSX 165	1 2.06	1.75	1.46
	2 1.24	1.05	0.96
	3 0.94	0.86	0.61

Low & Medium pressure filters

Filter element	Absolute filtration N-W Series					Nominal filtration N Series		
	A03	A06	A10	A16	A25	P10	P25	M25
CU 110	1 16.25	15.16	8.75	8.14	5.87	2.86	2.65	0.14
	2 12.62	10.44	6.11	6.02	4.15	1.60	1.49	0.12
	3 8.57	7.95	5.07	4.07	2.40	1.24	1.15	0.11
	4 5.76	4.05	2.80	2.36	1.14	0.91	0.85	0.05
CU 210	1 5.30	4.80	2.00	1.66	1.32	0.56	0.43	0.12
	2 3.44	2.95	1.24	1.09	0.70	0.42	0.35	0.09
	3 2.40	1.70	0.94	0.84	0.54	0.33	0.23	0.05
DN	016 7.95	7.20	3.00	2.49	1.98	0.84	0.65	0.18
	025 5.00	4.53	1.89	1.57	1.25	0.53	0.41	0.11
	040 3.13	2.66	1.12	0.98	0.63	0.38	0.32	0.08
CU 400	2 3.13	2.55	1.46	1.22	0.78	0.75	0.64	0.19
	3 2.15	1.70	0.94	0.78	0.50	0.40	0.34	0.10
	4 1.60	1.28	0.71	0.61	0.40	0.34	0.27	0.08
	5 1.00	0.83	0.47	0.34	0.20	0.24	0.19	0.06
	6 0.82	0.58	0.30	0.27	0.17	0.22	0.18	0.05
	CU 900 1 0.86	0.63	0.32	0.30	0.21	-	-	0.05
CU 950	2 1.03	0.80	0.59	0.40	0.26	-	-	0.05
	3 0.44	0.40	0.27	0.18	0.15	-	-	0.02
MR 630	7 0.88	0.78	0.36	0.34	0.16	0.12	0.96	0.47

FILTER SIZING Corrective factor

Corrective factor Y, to be used for the filter element pressure drop calculation.

The values depend to the filter size and lenght and to the filter media.

Reference viscosity 30 mm²/s

High pressure filters

Filter element	Absolute filtration N - R Series					Nominal filtration N Series
	A03	A06	A10	A16	A25	
Type	A03	A06	A10	A16	A25	M25
HP 011	1 332.71	250.07	184.32	152.36	128.36	-
	2 220.28	165.56	74.08	59.13	37.05	-
	3 123.24	92.68	41.48	33.08	20.72	-
	4 77.76	58.52	28.37	22.67	16.17	-
HP 039	1 70.66	53.20	25.77	20.57	14.67	4.90
	2 36.57	32.28	18.00	13.38	8.00	2.90
	3 26.57	23.27	12.46	8.80	5.58	2.20
HP 050	1 31.75	30.30	13.16	12.3	7.29	1.60
	2 24.25	21.26	11.70	9.09	4.90	1.40
	3 17.37	16.25	8.90	7.18	3.63	1.25
	4 12.12	10.75	6.10	5.75	3.08	1.07
	5 7.00	6.56	3.60	3.10	2.25	0.80
HP 065	1 58.50	43.46	23.16	19.66	10.71	1.28
	2 42.60	25.64	16.22	13.88	7.32	1.11
	3 20.50	15.88	8.18	6.81	3.91	0.58
HP 135	1 20.33	18.80	9.71	8.66	4.78	2.78
	2 11.14	10.16	6.60	6.38	2.22	1.11
	3 6.48	6.33	3.38	3.16	2.14	1.01
HP 320	1 10.88	9.73	5.02	3.73	2.54	1.04
	2 4.40	3.83	1.75	1.48	0.88	0.71
	3 2.75	2.11	1.05	0.87	0.77	0.61
	4 2.12	1.77	0.98	0.78	0.55	0.47
HP 500	1 4.44	3.67	2.30	2.10	1.65	0.15
	2 3.37	2.77	1.78	1.68	1.24	0.10
	3 2.22	1.98	1.11	1.09	0.75	0.08
	4 1.81	1.33	0.93	0.86	0.68	0.05
	5 1.33	1.15	0.77	0.68	0.48	0.04

Stainless steel high pressure filters

Filter element	Absolute filtration N Series				
	A03	A06	A10	A16	A25
Type	A03	A06	A10	A16	A25
HP 011	1 332.71	250.07	184.32	152.36	128.36
	2 220.28	165.56	74.08	59.13	37.05
	3 123.24	92.68	41.48	33.08	20.72
	4 77.76	58.52	28.37	22.67	16.17
HP 039	2 70.66	53.20	25.77	20.57	14.67
	3 36.57	32.28	18.00	13.38	8.00
	4 26.57	23.27	12.46	8.80	5.58
HP 050	1 31.75	30.30	13.16	12.3	7.29
	2 24.25	21.26	11.70	9.09	4.90
	3 17.37	16.25	8.90	7.18	3.63
	4 12.12	10.75	6.10	5.75	3.08
	5 7.00	6.56	3.60	3.10	2.25
HP 135	1 20.33	18.80	9.71	8.66	4.78
	2 11.14	10.16	6.60	6.38	2.22
	3 6.48	6.33	3.38	3.16	2.14
Filter element	Absolute filtration H - U Series				
	A03	A06	A10	A16	A25
	Type	A03	A06	A10	A16
HP 011	1 424.58	319.74	235.17	194.44	163.78
	2 281.06	211.25	94.53	75.45	47.26
	3 130.14	97.50	43.63	34.82	21.81
	4 109.39	82.25	36.79	29.37	18.40
HP 039	2 70.66	53.20	25.77	20.57	14.67
	3 36.57	32.28	18.00	13.38	8.00
	4 26.57	23.27	12.46	8.80	5.58
HP 050	1 47.33	34.25	21.50	20.50	14.71
	2 29.10	25.95	14.04	10.90	5.88
	3 20.85	19.50	10.68	8.61	4.36
	4 14.55	12.90	7.32	6.90	3.69
	5 9.86	9.34	6.40	4.80	2.50
HP 135	1 29.16	25.33	13.00	12.47	5.92
	2 14.28	11.04	7.86	7.60	4.44
	3 8.96	7.46	4.89	4.16	3.07

Filter element	Absolute filtration N Series					Nominal filtration N Series
	A03	A06	A10	A16	A25	
Type	A03	A06	A10	A16	A25	M25
HF 320	1 3.65	2.95	2.80	1.80	0.90	0.38
	2 2.03	1.73	1.61	1.35	0.85	0.36
	3 1.84	1.42	1.32	1.22	0.80	0.35

Selection Software FILTER SIZING

Step ① Select "FILTERS"





Step ② Choose filter group (Return Filter, Pressure Filter, etc.)



Step ③ Choose filter type (MPF, MPT, etc.) in function of the max working pressure and the max flow rate




Step ④ Push "PROCEED"

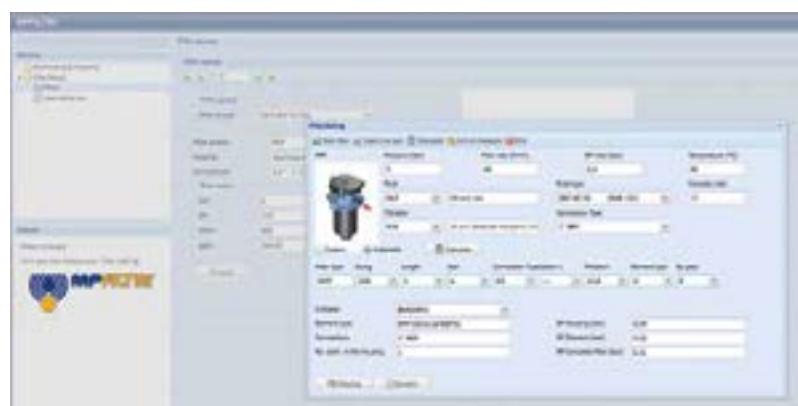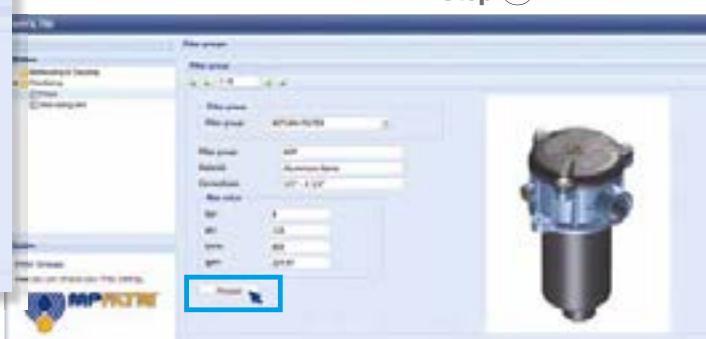

Step ⑤



Insert all application data to calculate the filter size following the sequence:

- working pressure
- working flow rate
- working pressure drop
- working temperature
- fluid material and fluid type
- filtration media
- connection type

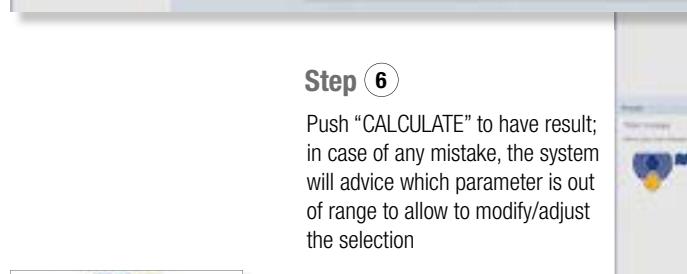

Step ⑥

Push "CALCULATE" to have result;
in case of any mistake, the system
will advice which parameter is out
of range to allow to modify/adjust
the selection

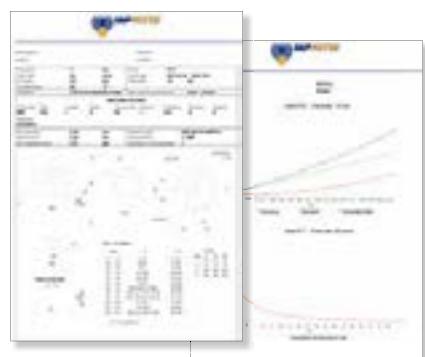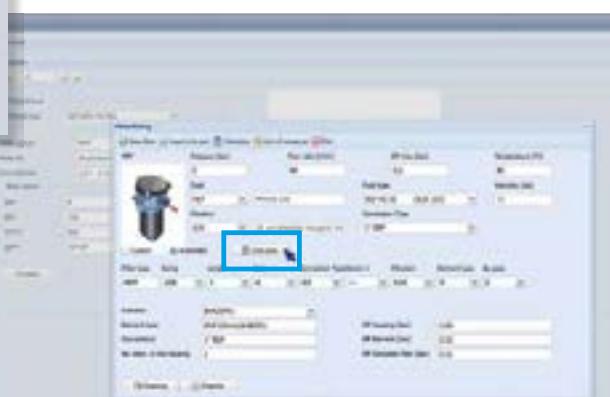

Step ⑦

Download PDF
Datasheet "Report.aspx" pushing the button "Drawing"

LMP 110-120 series

MULTIPORT

Maximum pressure up to 80 bar - Flow rate up to 200 l/min



Technical data

Low & Medium Pressure filters Maximum pressure up to 80 bar - Flow rate up to 200 l/min**Filter housing materials**

- Head: Aluminium
- Housing: Cataphoresis - Painted Steel
- Bypass valve: Brass - Aluminium

Seals

- Standard NBR series A
- Optional FPM series V

Pressure

- Working pressure: 8 MPa (80 bar)
- Test pressure: 12 MPa (120 bar)
- Burst pressure:
 - LMP 110: 29 MPa (290 bar)
 - LMP 120/130: 38 MPa (380 bar)
- Pulse pressure fatigue test: 1 000 000 cycles with pressure from 0 to 8 MPa (80 bar)

Temperature

From -25 °C to +110 °C

Note

LMP MULTIPORT filters are provided for vertical mounting

Bypass valve

- Opening pressure 3.5 bar ±10%
- Other opening pressures on request.

Δp element type

- Microfibre filter elements - series N - W: 20 bar
- Wire mesh filter elements - series N: 20 bar
- Fluid flow through the filter element from OUT to IN.


Weights [kg] and volumes [dm³]

	Weights [kg]					Volumes [dm ³]				
	Length	1	2	3	4	Length	1	2	3	4
LMP 110		1.60	1.80	2.10	2.60		0.75	0.81	1.11	1.53
LMP 120		1.90	2.10	2.40	2.90		0.75	0.81	1.11	1.53
LMP 123		1.70	1.90	2.20	2.70		0.75	0.81	1.11	1.53


Multiport




LMP 110
In-Line filter




LMP 120
Port IN-OUT on the same side





LMP 112
Double IN port




LMP 122
Lateral OUT port high flow






LMP 116
Double OUT port




LMP 123
Bypass valve for heat exchanger high flow



LMP 118
Bypass lateral. Always
cleaning fluid in OUT port





LMP 119
Safety valve 6 bar
for heat exchanger









Pressure drop

The curves are plotted using mineral oil with density of 0.86 kg/dm³ in compliance with ISO 3968.
 Δp varies proportionally with density.

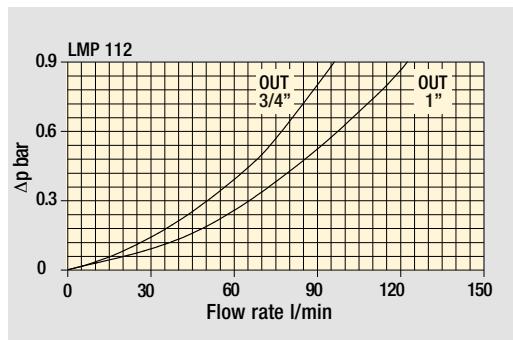
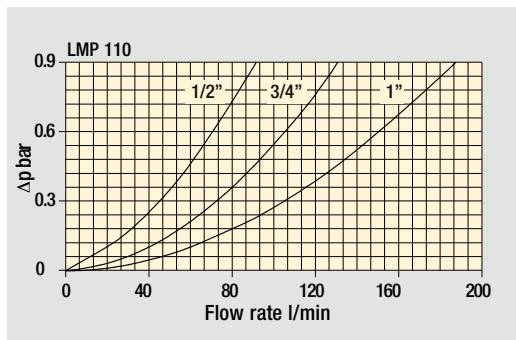


Filter housings Δp pressure drop

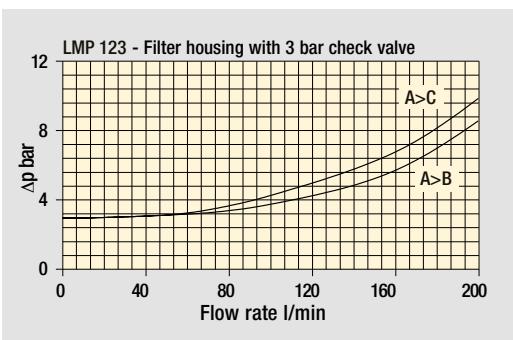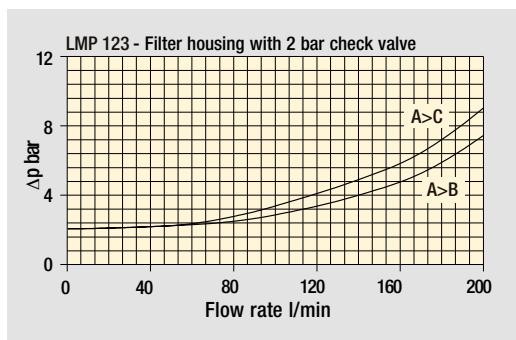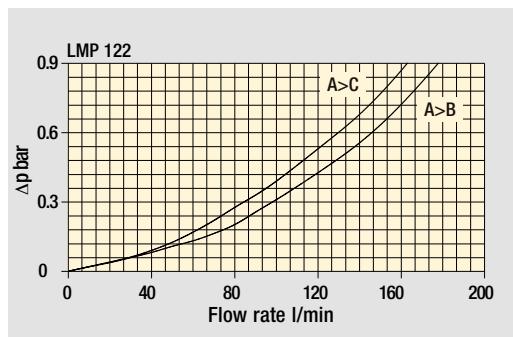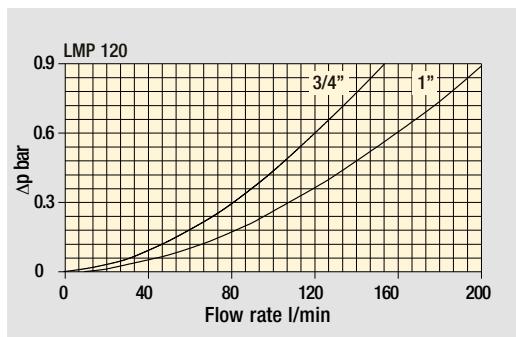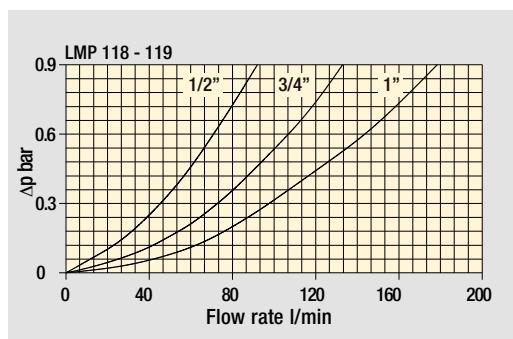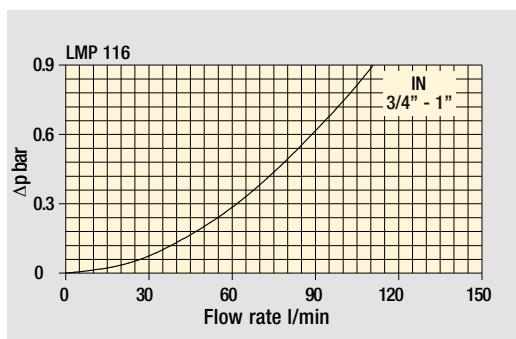


The curves are plotted using mineral oil with density of 0.86 kg/dm³ in compliance with ISO 3968.
Δp varies proportionally with density.

Pressure drop

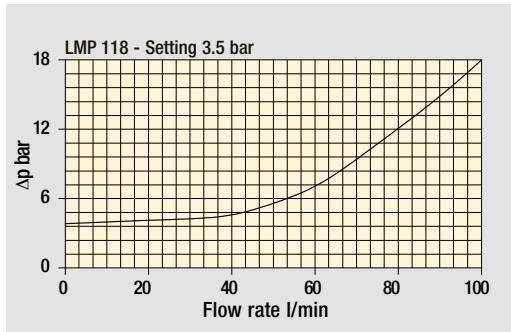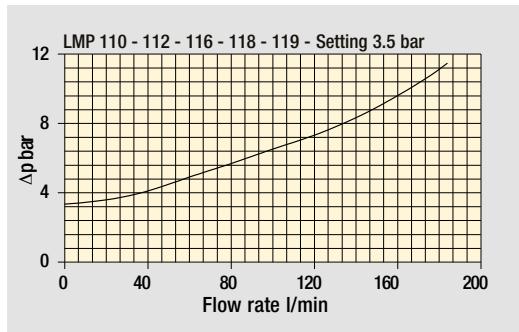

Bypass valve pressure drop

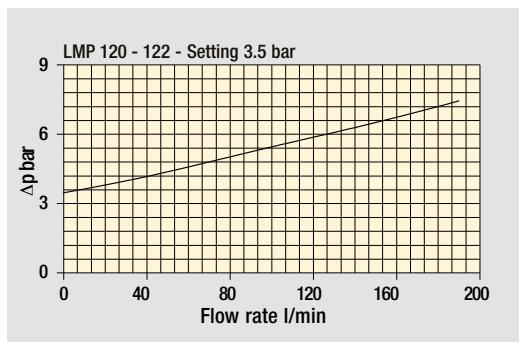

LMP LMP110 - LMP112 - LMP116

MULTIPOINT

Designation & Ordering code

COMPLETE FILTER

Series and size LMP110 LMP112 LMP116	Configuration example: LMP112 4 B A D 1 A10 N P01
Length 1 2 3 4	
Bypass valve S Without bypass B 3.5 bar	
Seals and treatments A NBR V FPM W NBR compatible with fluids HFA-HFB-HFC	Filtration rating Axx Mxx Pxx
Connections A G3/4" B G1" C 3/4" NPT D 1" NPT E SAE 12 - 1 1/16" - 12 UN F SAE 16 - 1 5/16" - 12 UN	Aux (only LMP 112 - 116)
Connection for differential indicator 1 Without 2 With standard connection 3 With connection on the opposite side 6 With two connections on both sides	
Filtration rating (filter media) A03 Inorganic microfiber 3 µm A06 Inorganic microfiber 6 µm A10 Inorganic microfiber 10 µm A16 Inorganic microfiber 16 µm A25 Inorganic microfiber 25 µm	M25 Wire mesh 25 µm M60 Wire mesh 60 µm M90 Wire mesh 90 µm P10 Resin impregnated paper 10 µm P25 Resin impregnated paper 25 µm
Element Δp N 20 bar	Execution P01 MP Filtri standard Pxx Customized


FILTER ELEMENT

Element series and size CU110	Configuration example: CU110 4 A10 A N P01
Element length 1 2 3 4	
Filtration rating (filter media) A03 Inorganic microfiber 3 µm A06 Inorganic microfiber 6 µm A10 Inorganic microfiber 10 µm A16 Inorganic microfiber 16 µm A25 Inorganic microfiber 25 µm	M25 Wire mesh 25 µm M60 Wire mesh 60 µm M90 Wire mesh 90 µm P10 Resin impregnated paper 10 µm P25 Resin impregnated paper 25 µm
Seals A NBR V FPM W NBR compatible with fluids HFA-HFB-HFC	Filtration rating Axx Mxx Pxx
Element Δp N 20 bar	Execution P01 MP Filtri standard Pxx Customized


ACCESSORIES

Differential indicators DEA Electrical differential indicator	page 419	DTA Electronic differential indicator	page 422
DEM Electrical differential indicator	419-420	DVA Visual differential indicator	422
DLA Electrical / visual differential indicator	420-421	DVM Visual differential indicator	422
DLE Electrical / visual differential indicator	421		
Additional features T2 Plug	page 423		

LMP110 - LMP112 LMP116	
Filter length	H [mm]
1	182
2	215
3	265
4	365

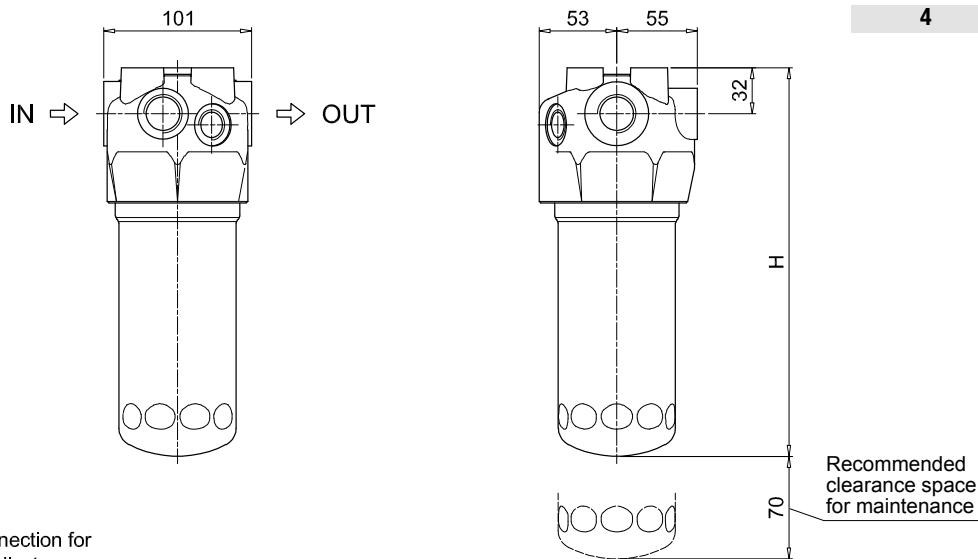


2 - Standard connection for differential indicator
T2 plug not included




3 - Connection for differential indicator on the opposite side
T2 plug not included

Fixing holes
Option for Metric and UNC screws


M10 x depth 12
Nr. 4 holes




LMP110



LMP112



LMP116



↑
Aux
IN

↓
Aux
OUT

Designation & Ordering code

COMPLETE FILTER										
Series and size		Configuration example: LMP118 4 B A D 1 A10 N P01								
LMP118 LMP119										
Length										
1 2 3 4										
Bypass valve										
B 3.5 bar										
Seals and treatments		Filtration rating								
A NBR		Axx	Mxx	Pxx						
V FPM		•	•	•						
W NBR compatible with fluids HFA-HFB-HFC		•	•							
Connections		Aux OUT								
A G3/4"		G3/4"								
B G1"		G3/4"								
C 3/4" NPT		3/4" NPT								
D 1" NPT		3/4" NPT								
E SAE 12 - 1 1/16" - 12 UN		SAE 12 - 1 1/16" - 12 UN								
F SAE 16 - 1 5/16" - 12 UN		SAE 12 - 1 1/16" - 12 UN								
Connection for differential indicator										
1 Without										
2 With standard connection										
Filtration rating (filter media)										
A03 Inorganic microfiber 3 µm		M25 Wire mesh 25 µm								
A06 Inorganic microfiber 6 µm		M60 Wire mesh 60 µm								
A10 Inorganic microfiber 10 µm		M90 Wire mesh 90 µm								
A16 Inorganic microfiber 16 µm		P10 Resin impregnated paper 10 µm								
A25 Inorganic microfiber 25 µm		P25 Resin impregnated paper 25 µm								
Seals		Element Δp								
A NBR		Axx	Mxx	Pxx						
V FPM		•	•	•						
W NBR compatible with fluids HFA-HFB-HFC		•	•							
Execution										
P01 MP Filtri standard										
Pxx Customized										



FILTER ELEMENT										
Element series and size		Configuration example: CU110 4 A10 A N P01								
CU110										
Element length										
1 2 3 4										
Filtration rating (filter media)										
A03 Inorganic microfiber 3 µm		M25 Wire mesh 25 µm								
A06 Inorganic microfiber 6 µm		M60 Wire mesh 60 µm								
A10 Inorganic microfiber 10 µm		M90 Wire mesh 90 µm								
A16 Inorganic microfiber 16 µm		P10 Resin impregnated paper 10 µm								
A25 Inorganic microfiber 25 µm		P25 Resin impregnated paper 25 µm								
Seals		Element Δp								
A NBR		Axx	Mxx	Pxx						
V FPM		•	•	•						
W NBR compatible with fluids HFA-HFB-HFC		•	•							
Execution										
P01 MP Filtri standard										
Pxx Customized										

ACCESSORIES


Differential indicators	page	DTA Electronic differential indicator	page
DEA Electrical differential indicator	419	DVA Visual differential indicator	422
DEM Electrical differential indicator	419-420	DVM Visual differential indicator	422
DLA Electrical / visual differential indicator	420-421		
DLE Electrical / visual differential indicator	421		
Additional features	page		
T2 Plug	423		

LMP118 - LMP119



Filter length	H [mm]
1	182
2	215
3	265
4	365

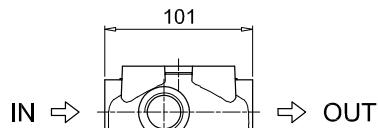

Recommended clearance space for maintenance

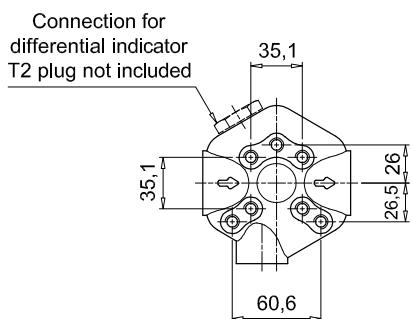

Fixing holes
Option for Metric and UNC screws

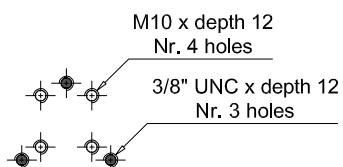

Aux
OUT



Designation & Ordering code

COMPLETE FILTER										
Series and size		Configuration example: LMP112 4 B A D 1 A10 N P01								
LMP120 LMP122										
Length										
1 2 3 4										
Bypass valve										
S Without bypass		B 3.5 bar								
Seals and treatments		Filtration rating								
A NBR		Axx	Mxx	Pxx						
V FPM		•	•	•						
W NBR compatible with fluids HFA-HFB-HFC		•	•							
Connections		LMP120	LMP122							
A G3/4"		•								
B G1"		•	•							
C 3/4" NPT		•								
D 1" NPT		•	•							
E SAE 12 - 1 1/16" - 12 UN		•								
F SAE 16 - 1 5/16" - 12 UN		•	•							
Connection for differential indicator										
1 Without										
2 With standard connection										
Filtration rating (filter media)										
A03 Inorganic microfiber 3 µm		M25 Wire mesh 25 µm								
A06 Inorganic microfiber 6 µm		M60 Wire mesh 60 µm								
A10 Inorganic microfiber 10 µm		M90 Wire mesh 90 µm								
A16 Inorganic microfiber 16 µm		P10 Resin impregnated paper 10 µm								
A25 Inorganic microfiber 25 µm		P25 Resin impregnated paper 25 µm								
Seals		Axx	Mxx	Pxx						
A NBR		•	•	•						
V FPM		•	•	•						
W NBR compatible with fluids HFA-HFB-HFC		•	•							
Element Δp										
N 20 bar										
Execution										
P01 MP Filtri standard										
Pxx Customized										

FILTER ELEMENT										
Element series and size		Configuration example: CU110 4 A10 A N P01								
CU110										
Element length										
1 2 3 4										
Filtration rating (filter media)										
A03 Inorganic microfiber 3 µm		M25 Wire mesh 25 µm								
A06 Inorganic microfiber 6 µm		M60 Wire mesh 60 µm								
A10 Inorganic microfiber 10 µm		M90 Wire mesh 90 µm								
A16 Inorganic microfiber 16 µm		P10 Resin impregnated paper 10 µm								
A25 Inorganic microfiber 25 µm		P25 Resin impregnated paper 25 µm								
Filtration rating		Axx	Mxx	Pxx						
Seals		Axx	Mxx	Pxx						
A NBR		•	•	•						
V FPM		•	•	•						
W NBR compatible with fluids HFA-HFB-HFC		•	•							
Element Δp										
N 20 bar										
Execution										
P01 MP Filtri standard										
Pxx Customized										

ACCESSORIES

Differential indicators	page	DTA	Electronic differential indicator	page
DEA Electrical differential indicator	419			422
DEM Electrical differential indicator	419-420			422
DLA Electrical / visual differential indicator	420-421			422
DLE Electrical / visual differential indicator	421			
Additional features	page	DVA	Visual differential indicator	page
T2 Plug	423			422

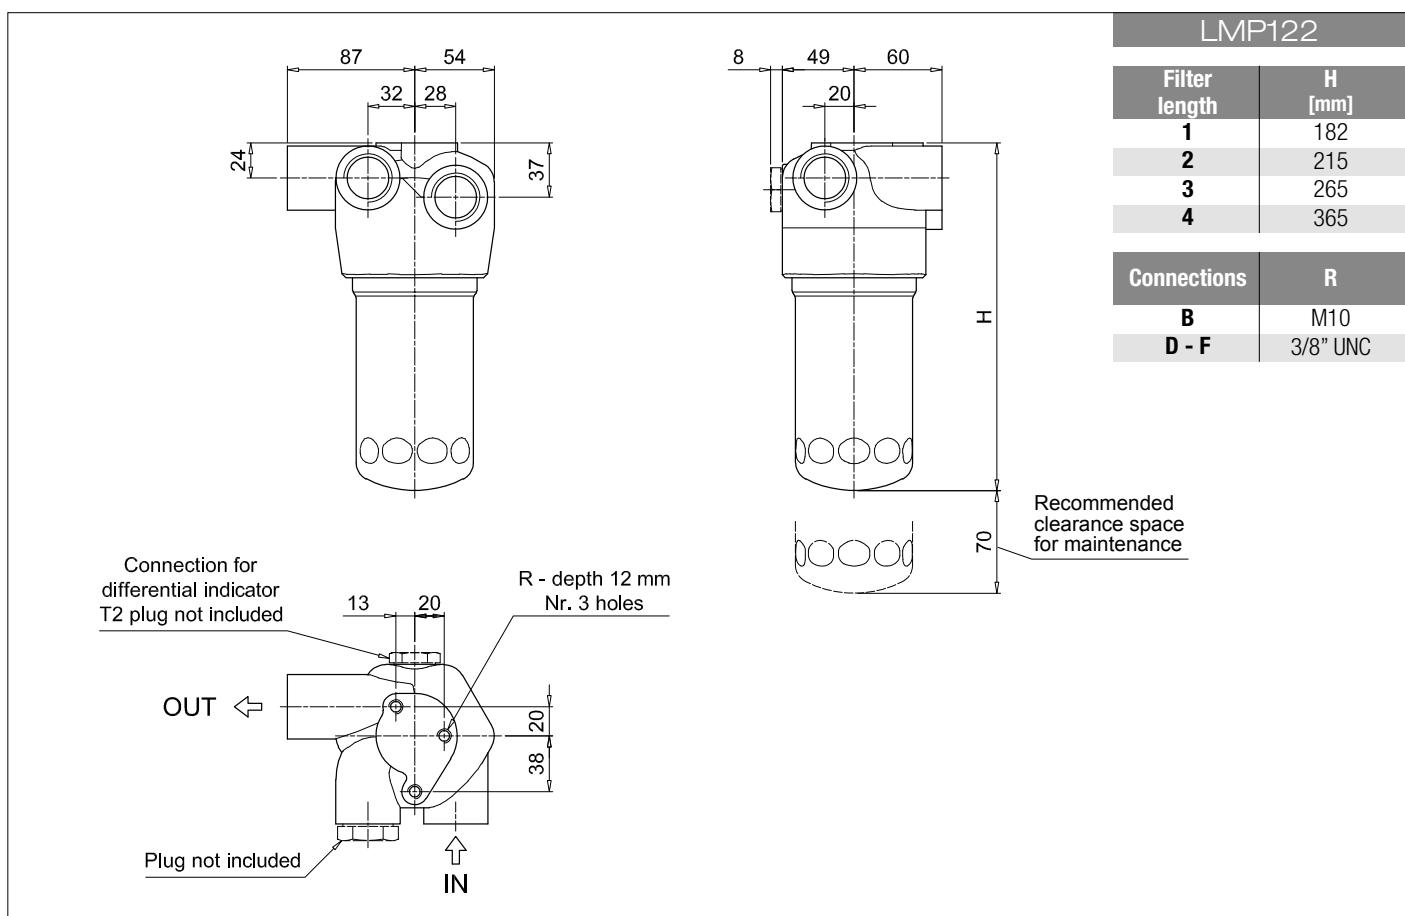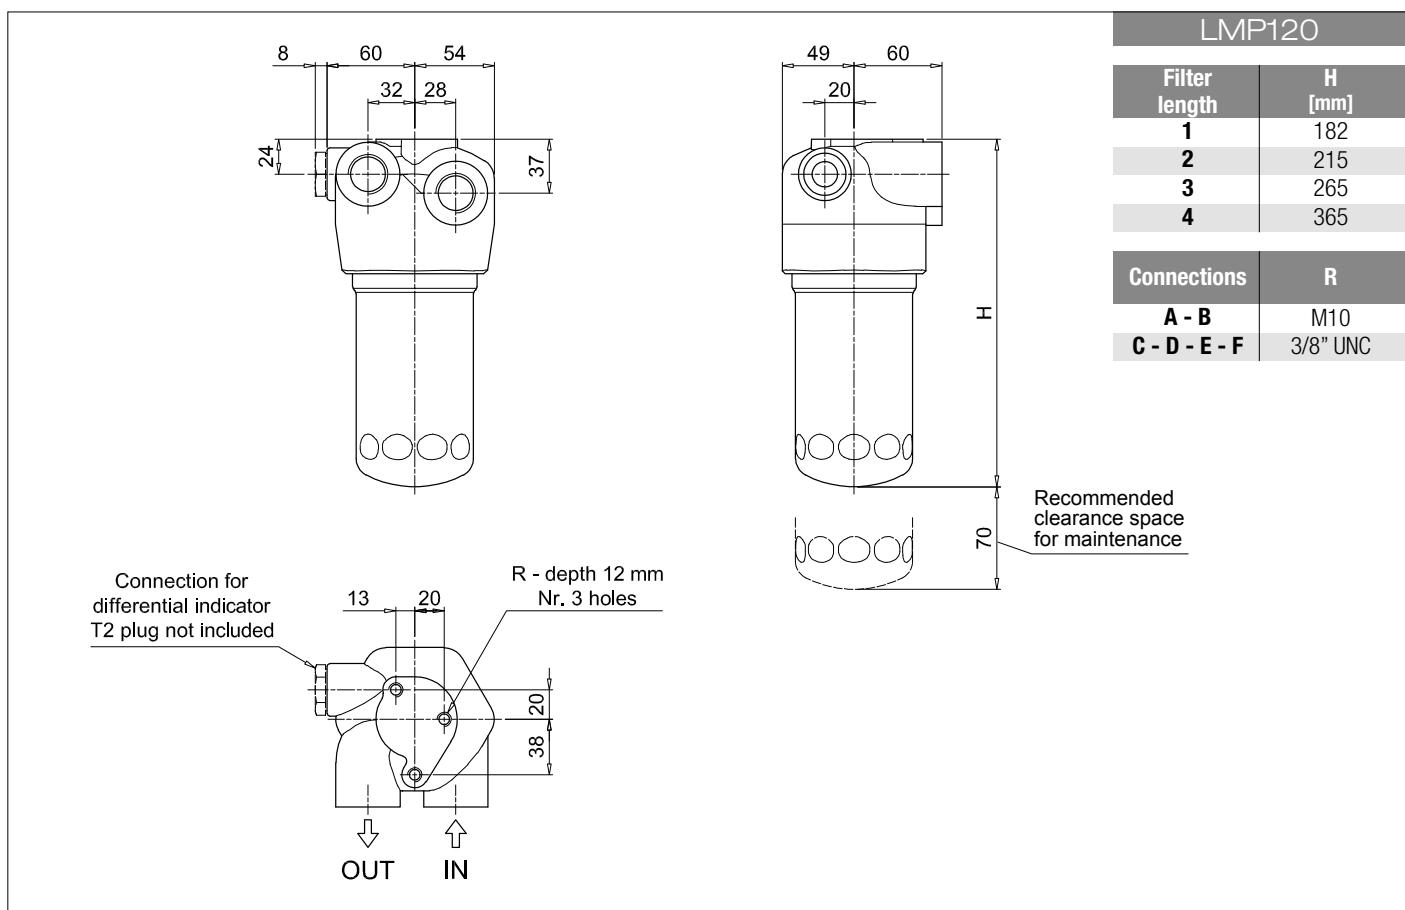

Designation & Ordering code

COMPLETE FILTER

Series and size		Configuration example: LMP123 4 R A F 1 A10 N P01								
LMP123										
Length										
1	2	3	4							
Valves	Bypass	OUT to cooler	Check valve							
C	without	front	2 bar							
D			3 bar							
G	3.5 bar	side	2 bar							
H			3 bar							
M	3.5 bar	front	2 bar							
N			3 bar							
Q	3.5 bar	side	2 bar							
R			3 bar							
Filtration rating										
Seals and treatments		Axx	Mxx	Pxx						
A	NBR	•	•	•						
V	FPM	•	•	•						
W	NBR compatible with fluids HFA-HFB-HFC	•	•							
Connections										
B	G1"									
F	SAE 16 - 1 5/16" - 12 UN									
Connection for differential indicator										
1	Without									
2	With standard connection									
Filtration rating (filter media)										
A03	Inorganic microfiber 3 µm	M25	Wire mesh 25 µm							
A06	Inorganic microfiber 6 µm	M60	Wire mesh 60 µm							
A10	Inorganic microfiber 10 µm	M90	Wire mesh 90 µm							
A16	Inorganic microfiber 16 µm	P10	Resin impregnated paper 10 µm							
A25	Inorganic microfiber 25 µm	P25	Resin impregnated paper 25 µm							
Element Δp										
N	20 bar									
Execution										
P01	MP Filtri standard									
Pxx	Customized									


FILTER ELEMENT

Element series and size		Configuration example: CU110 4 A10 A N P01							
CU110									
Element length									
1	2	3	4						
Filtration rating (filter media)									
A03	Inorganic microfiber 3 µm	M25	Wire mesh 25 µm						
A06	Inorganic microfiber 6 µm	M60	Wire mesh 60 µm						
A10	Inorganic microfiber 10 µm	M90	Wire mesh 90 µm						
A16	Inorganic microfiber 16 µm	P10	Resin impregnated paper 10 µm						
A25	Inorganic microfiber 25 µm	P25	Resin impregnated paper 25 µm						
Filtration rating									
Seals	Axx	Mxx	Pxx						
A	NBR	•	•	•					
V	FPM	•	•	•					
W	NBR compatible with fluids HFA-HFB-HFC	•	•						
Element Δp									
N	20 bar								
Execution									
P01	MP Filtri standard								
Pxx	Customized								

ACCESSORIES

Differential indicators	page
DEA Electrical differential indicator	419
DEM Electrical differential indicator	419-420
DLA Electrical / visual differential indicator	420-421
DLE Electrical / visual differential indicator	421
Additional features	page
T2 Plug	423

DTA Electronic differential indicator	page
DVA Visual differential indicator	422
DVM Visual differential indicator	422

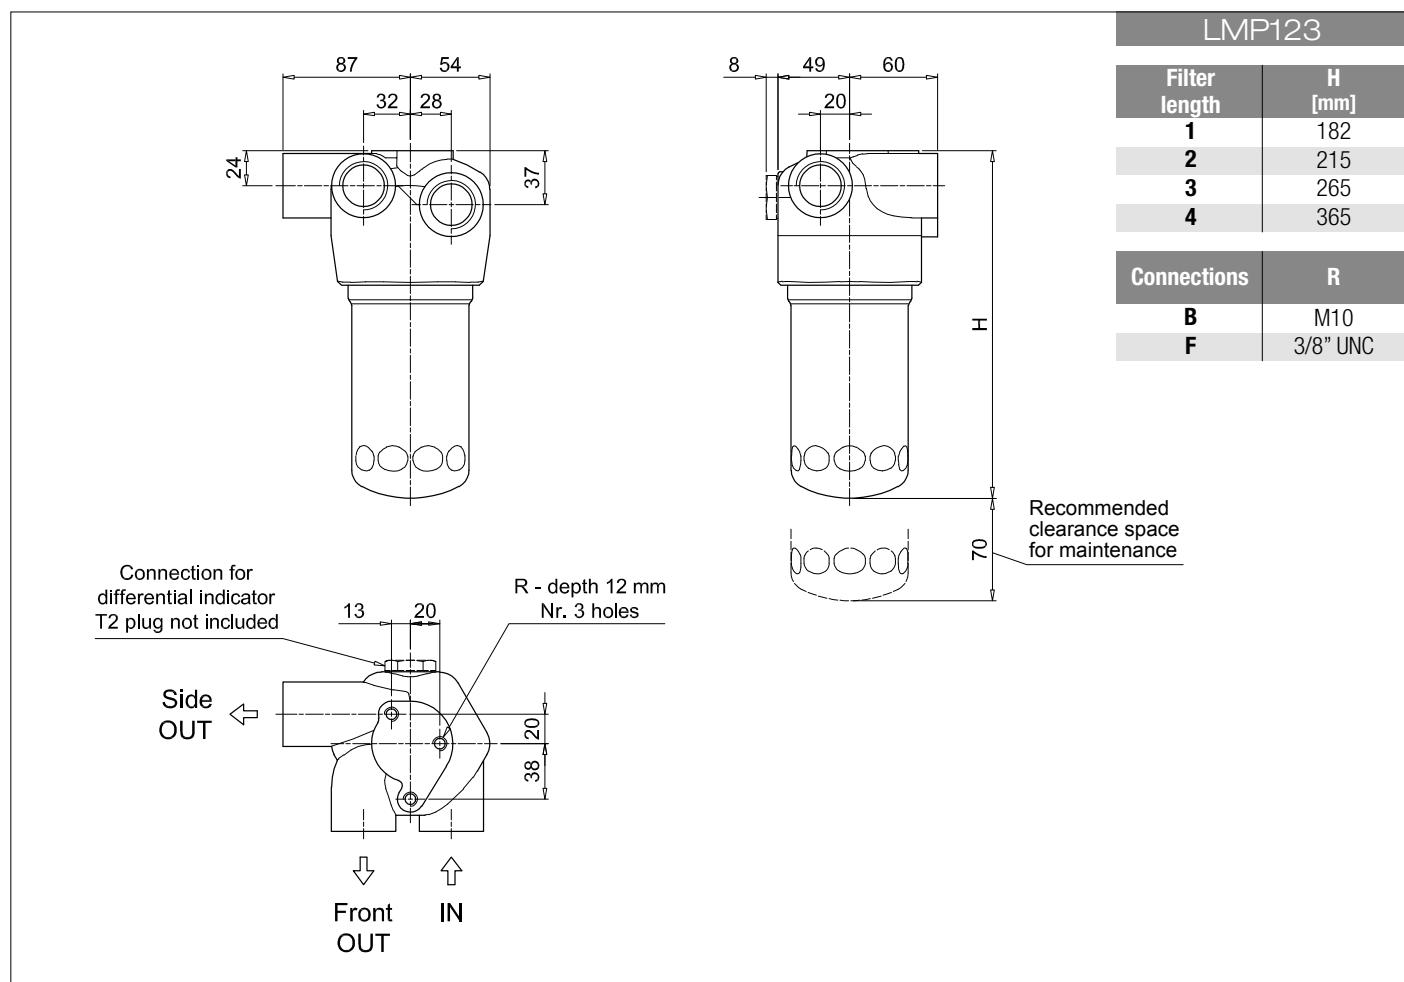


Order number for spare parts

LMP 110 - 112 - 116 - 118 - 119

LMP 120

LMP 122 - 123

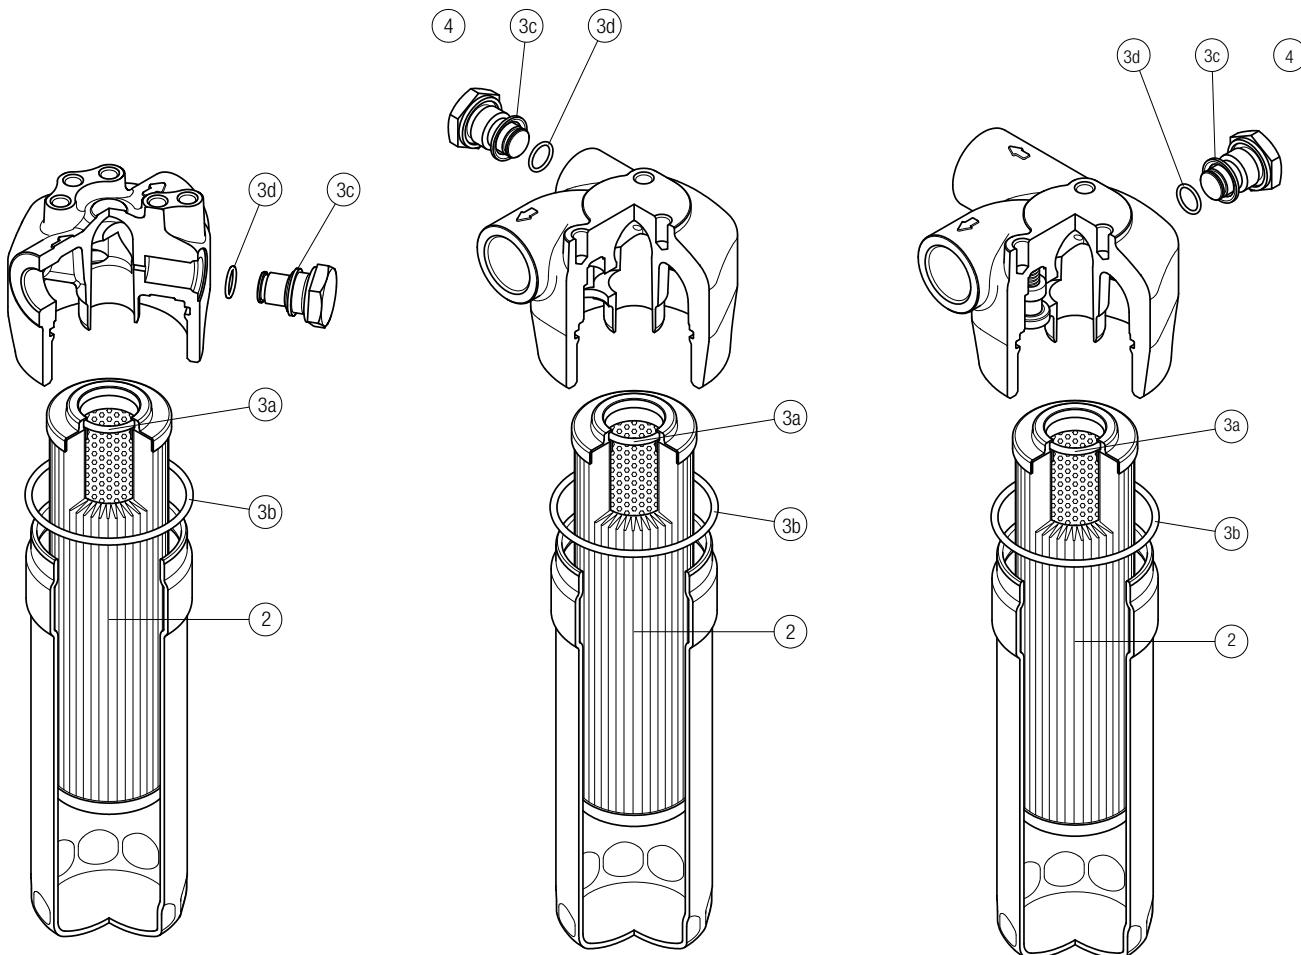

Item:	Q.ty: 1 pc. 2	Q.ty: 1 pc. 3 (3a ÷ 3d)	Q.ty: 1 pc. 4
Filter series	Filter element	Seal Kit code number NBR FPM	Indicator connection plug NBR FPM
LMP 110 - 112- 116 - 118 - 119	See order table	02050478 02050479	T2H T2V
LMP 120			
LMP 122 - 123			