


# MRSX series

Maximum pressure up to 10 bar - Flow rate up to 300 l/min

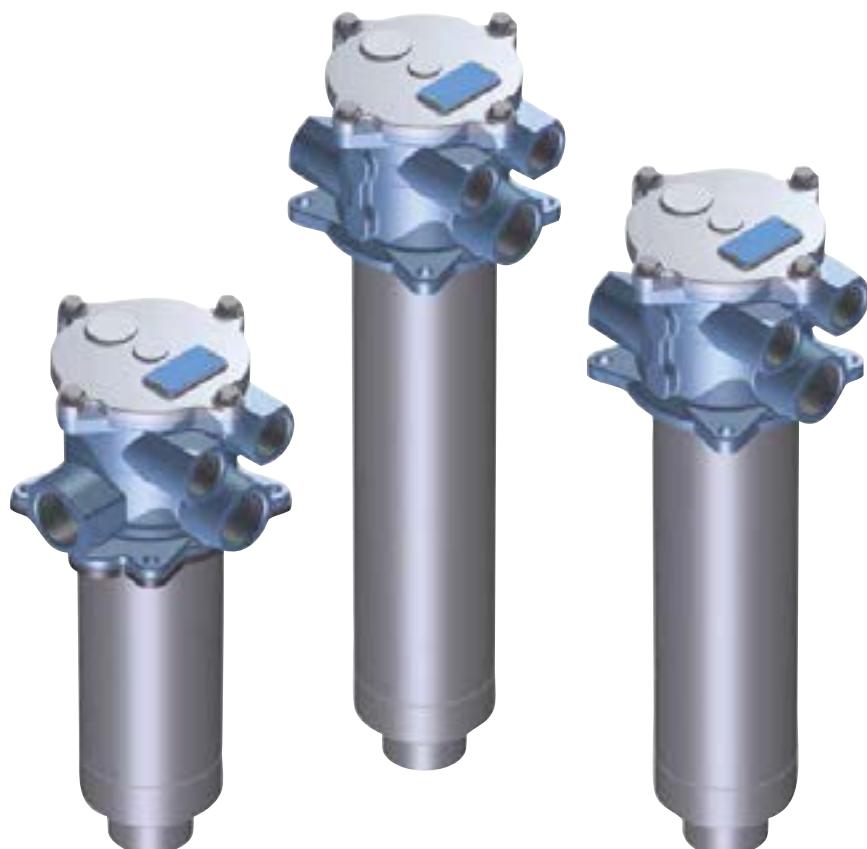

# FILTER SIZING

## Corrective factor

The correct filter sizing have to be based on the variable pressure drop depending by the application. For example, for the return filter the pressure drop have to be in the range 0.4 - 0.6 bar.

The pressure drop calculation is performed by adding together the value of the housing with the value of the filter element. The pressure drop in the housing is proportional to the fluid density ( $\text{kg}/\text{dm}^3$ ); all the graphs in the catalogue are referred to mineral oil with density of  $0.86 \text{ kg}/\text{dm}^3$ .

The filter element pressure drop is proportional to its viscosity ( $\text{mm}^2/\text{s}$ ), the corrective factor Y is related to an oil viscosity different than  $30 \text{ mm}^2/\text{s}$ .

### Sizing data for single cartridge, head at top

$\Delta p_c$  = Filter housing pressure drop [bar]

$\Delta p_e$  = Filter element pressure drop [bar]

**Y** = Multiplication factor Y (see correspondent table), depending on the filter element size, on the filter element lenght and on the filter media

**Q** = flow rate ( $\text{l}/\text{min}$ )

**V1 reference viscosity** =  $30 \text{ mm}^2/\text{s}$  (cSt)

**V2** = operating viscosity in  $\text{mm}^2/\text{s}$  (cSt)

$\Delta p_e = Y : 1000 \times Q \times (V2/V1)$

$\Delta p_{\text{Tot.}} = \Delta p_c + \Delta p_e$

### Calculation examples with HLP Mineral oil Variation in viscosity

**Application data:**

Top tank return filter

Filter with in-line connections

Pressure  $P_{\text{max}} = 10 \text{ bar}$

Flow rate  $Q = 120 \text{ l}/\text{min}$

Viscosity  $V_2 = 46 \text{ mm}^2/\text{s}$  (cSt)

Oil viscosity =  $0.86 \text{ kg}/\text{dm}^3$

Required filtration efficiency =  $25 \mu\text{m}$  with absolute filtration

With bypass valve and  $1 \frac{1}{4}$ " inlet connection

From the working pressure and the flow rate we understand it should be possible using the following top tank return filter series: MPT, MPH and FRI. Let's proceed with MPT series.


The size 20 doesn't achieve the required flow rate, therefore we have to consider the size 100. The final version of size 100 (101, 104, 110, 120 and 114) will be then defined in function of the mounting characteristics.

**$\Delta p_c = 0.03 \text{ bar}$**  (★ see graphic below, considering size 100 with the max available lenght to get the lowest pressure drop)

**$\Delta p_e = (2.0 : 1000) \times 120 \times (46/30) = 0.37 \text{ bar}$**

**$\Delta p_{\text{Tot.}} = 0.03 + 0.37 = 0.4 \text{ bar}$**

The selection is correct because the total pressure drop value is inside the admissible range for top tank return filters. It is of course possible trying to find a different solution, according to the mounting position or to other commercial need, repeating the previous steps while using a different series or lenght.

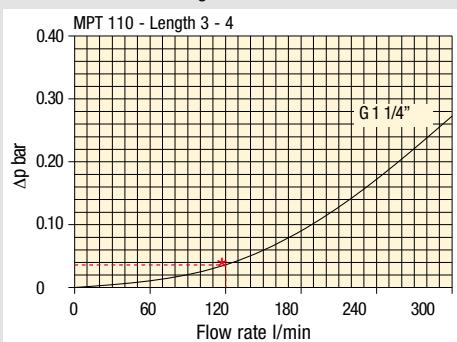

### Filter housings $\Delta p$ pressure drop.

The curves are plotted using mineral oil with density of  $0.86 \text{ kg}/\text{dm}^3$  in compliance with ISO 3968.  $\Delta p$  varies proportionally with density.

### Corrective factor Y, to be used for the filter element pressure drop calculation.

The values depend to the filter size and lenght and to the filter media.

Reference viscosity  $30 \text{ mm}^2/\text{s}$

### Return filters

Filter element	Absolute filtration H Series					Nominal filtration N Series			
	Type	A03	A06	A10	A16	A25	P10	P25	M25 M60 M90
<b>MF 020</b>	1	74.00	50.08	20.00	16.00	9.00	6.43	5.51	4.40
	2	29.20	24.12	8.00	7.22	5.00	3.33	2.85	2.00
	3	22.00	19.00	6.56	5.33	4.33	1.68	1.44	1.30
<b>MF 030</b> <b>MFX 030</b>	1	74.00	50.08	20.00	16.00	9.00	6.43	5.51	3.40
<b>MF 100</b> <b>MFX 100</b>	1	28.20	24.40	8.67	8.17	6.88	4.62	3.96	1.25
	2	17.33	12.50	6.86	5.70	4.00	3.05	2.47	1.10
	3	10.25	9.00	3.65	3.33	2.50	1.63	1.32	0.96
	4	6.10	5.40	2.30	2.20	2.00	1.19	0.96	0.82
<b>MF 180</b> <b>MFX 180</b>	1	3.67	3.05	1.64	1.56	1.24	1.18	1.06	0.26
<b>MF 190</b> <b>MFX 190</b>	2	1.69	1.37	0.68	0.54	0.51	0.43	0.39	0.12
	1	1.69	1.37	0.60	0.49	0.44	0.35	0.31	0.11
<b>MF 400</b> <b>MFX 400</b>	1	3.20	2.75	1.39	1.33	1.06	0.96	0.87	0.22
	2	2.00	1.87	0.88	0.85	0.55	0.49	0.45	0.13
	3	1.90	1.60	0.63	0.51	0.49	0.39	0.35	0.11
<b>MF 750</b> <b>MFX 750</b>	1	1.08	0.84	0.49	0.36	0.26	0.21	0.19	0.06
<b>CU 025</b>		78.00	48.00	28.00	24.00	9.33	9.33	8.51	1.25
<b>CU 040</b>		25.88	20.88	10.44	10.00	3.78	3.78	3.30	1.25
<b>CU 100</b>		15.20	14.53	5.14	4.95	2.00	2.00	0.17	1.10
<b>CU 250</b>		3.25	2.55	1.55	1.35	0.71	0.71	0.59	0.25
<b>CU 630</b>		1.96	1.68	0.85	0.72	0.42	0.42	0.36	0.09
<b>CU 850</b>		1.06	0.84	0.42	0.33	0.17	0.17	0.13	0.04
<b>MR 100</b>	1	19.00	17.00	6.90	6.30	4.60	2.94	2.52	1.60
	2	11.70	10.80	4.40	4.30	3.00	2.94	2.52	1.37
	3	7.80	6.87	3.70	3.10	2.70	2.14	1.84	1.34
	4	5.50	4.97	2.60	2.40	2.18	1.72	1.47	1.34
	5	4.20	3.84	2.36	2.15	1.90	1.60	1.37	1.34
<b>MR 250</b>	1	5.35	4.85	2.32	1.92	1.50	1.38	1.20	0.15
	2	4.00	3.28	1.44	1.10	1.07	0.96	0.83	0.13
	3	2.60	2.20	1.08	1.00	0.86	0.77	0.64	0.12
	4	1.84	1.56	0.68	0.56	0.44	0.37	0.23	0.11
<b>MR 630</b>	1	3.10	2.48	1.32	1.14	0.92	0.83	0.73	0.09
	2	2.06	1.92	0.82	0.76	0.38	0.33	0.27	0.08
	3	1.48	1.30	0.60	0.56	0.26	0.22	0.17	0.08
	4	1.30	1.20	0.48	0.40	0.25	0.21	0.16	0.08
	5	0.74	0.65	0.30	0.28	0.13	0.10	0.08	0.04
<b>MR 850</b>	1	0.60	0.43	0.34	0.25	0.13	0.12	0.09	0.03
	2	0.37	0.26	0.23	0.21	0.11	0.08	0.07	0.03
	3	0.27	0.18	0.17	0.17	0.05	0.04	0.04	0.02
	4	0.23	0.16	0.13	0.12	0.04	0.03	0.03	0.02

**Corrective factor Y, to be used for the filter element pressure drop calculation.**

The values depend to the filter size and lenght and to the filter media.

Reference viscosity 30 mm<sup>2</sup>/s

### Suction filters

Filter element	Nominal filtration N Series	
	P10	P25
<b>SF 250</b>	65	21

### Return / Suction filters

Filter element	Absolute filtration		
	A10	A16	A25
<b>RSX 116</b>	1   5.12	4.33	3.85
	2   2.22	1.87	1.22
<b>RSX 165</b>	1   2.06	1.75	1.46
	2   1.24	1.05	0.96
	3   0.94	0.86	0.61

### Low & Medium pressure filters

Filter element	Absolute filtration N-W Series					Nominal filtration N Series		
	A03	A06	A10	A16	A25	P10	P25	M25
<b>CU 110</b>	1   16.25	15.16	8.75	8.14	5.87	2.86	2.65	0.14
	2   12.62	10.44	6.11	6.02	4.15	1.60	1.49	0.12
	3   8.57	7.95	5.07	4.07	2.40	1.24	1.15	0.11
	4   5.76	4.05	2.80	2.36	1.14	0.91	0.85	0.05
<b>CU 210</b>	1   5.30	4.80	2.00	1.66	1.32	0.56	0.43	0.12
	2   3.44	2.95	1.24	1.09	0.70	0.42	0.35	0.09
	3   2.40	1.70	0.94	0.84	0.54	0.33	0.23	0.05
<b>DN</b>	016   7.95	7.20	3.00	2.49	1.98	0.84	0.65	0.18
	025   5.00	4.53	1.89	1.57	1.25	0.53	0.41	0.11
	040   3.13	2.66	1.12	0.98	0.63	0.38	0.32	0.08
<b>CU 400</b>	2   3.13	2.55	1.46	1.22	0.78	0.75	0.64	0.19
	3   2.15	1.70	0.94	0.78	0.50	0.40	0.34	0.10
	4   1.60	1.28	0.71	0.61	0.40	0.34	0.27	0.08
	5   1.00	0.83	0.47	0.34	0.20	0.24	0.19	0.06
	6   0.82	0.58	0.30	0.27	0.17	0.22	0.18	0.05
	<b>CU 900</b>   1   0.86	0.63	0.32	0.30	0.21	-	-	0.05
<b>CU 950</b>	2   1.03	0.80	0.59	0.40	0.26	-	-	0.05
	3   0.44	0.40	0.27	0.18	0.15	-	-	0.02
<b>MR 630</b>	7   0.88	0.78	0.36	0.34	0.16	0.12	0.96	0.47

# FILTER SIZING Corrective factor

Corrective factor Y, to be used for the filter element pressure drop calculation.

The values depend to the filter size and lenght and to the filter media.

Reference viscosity 30 mm<sup>2</sup>/s

## High pressure filters

Filter element	Absolute filtration N - R Series					Nominal filtration N Series
	A03	A06	A10	A16	A25	
Type	A03	A06	A10	A16	A25	M25
<b>HP 011</b>	1 332.71	250.07	184.32	152.36	128.36	-
	2 220.28	165.56	74.08	59.13	37.05	-
	3 123.24	92.68	41.48	33.08	20.72	-
	4 77.76	58.52	28.37	22.67	16.17	-
<b>HP 039</b>	1 70.66	53.20	25.77	20.57	14.67	4.90
	2 36.57	32.28	18.00	13.38	8.00	2.90
	3 26.57	23.27	12.46	8.80	5.58	2.20
<b>HP 050</b>	1 31.75	30.30	13.16	12.3	7.29	1.60
	2 24.25	21.26	11.70	9.09	4.90	1.40
	3 17.37	16.25	8.90	7.18	3.63	1.25
	4 12.12	10.75	6.10	5.75	3.08	1.07
	5 7.00	6.56	3.60	3.10	2.25	0.80
<b>HP 065</b>	1 58.50	43.46	23.16	19.66	10.71	1.28
	2 42.60	25.64	16.22	13.88	7.32	1.11
	3 20.50	15.88	8.18	6.81	3.91	0.58
<b>HP 135</b>	1 20.33	18.80	9.71	8.66	4.78	2.78
	2 11.14	10.16	6.60	6.38	2.22	1.11
	3 6.48	6.33	3.38	3.16	2.14	1.01
<b>HP 320</b>	1 10.88	9.73	5.02	3.73	2.54	1.04
	2 4.40	3.83	1.75	1.48	0.88	0.71
	3 2.75	2.11	1.05	0.87	0.77	0.61
	4 2.12	1.77	0.98	0.78	0.55	0.47
<b>HP 500</b>	1 4.44	3.67	2.30	2.10	1.65	0.15
	2 3.37	2.77	1.78	1.68	1.24	0.10
	3 2.22	1.98	1.11	1.09	0.75	0.08
	4 1.81	1.33	0.93	0.86	0.68	0.05
	5 1.33	1.15	0.77	0.68	0.48	0.04

## Stainless steel high pressure filters

Filter element	Absolute filtration N Series				
	A03	A06	A10	A16	A25
Type	A03	A06	A10	A16	A25
<b>HP 011</b>	1 332.71	250.07	184.32	152.36	128.36
	2 220.28	165.56	74.08	59.13	37.05
	3 123.24	92.68	41.48	33.08	20.72
	4 77.76	58.52	28.37	22.67	16.17
<b>HP 039</b>	2 70.66	53.20	25.77	20.57	14.67
	3 36.57	32.28	18.00	13.38	8.00
	4 26.57	23.27	12.46	8.80	5.58
<b>HP 050</b>	1 31.75	30.30	13.16	12.3	7.29
	2 24.25	21.26	11.70	9.09	4.90
	3 17.37	16.25	8.90	7.18	3.63
	4 12.12	10.75	6.10	5.75	3.08
	5 7.00	6.56	3.60	3.10	2.25
<b>HP 135</b>	1 20.33	18.80	9.71	8.66	4.78
	2 11.14	10.16	6.60	6.38	2.22
	3 6.48	6.33	3.38	3.16	2.14
Filter element	Absolute filtration H - U Series				
	A03	A06	A10	A16	A25
	Type	A03	A06	A10	A16
<b>HP 011</b>	1 424.58	319.74	235.17	194.44	163.78
	2 281.06	211.25	94.53	75.45	47.26
	3 130.14	97.50	43.63	34.82	21.81
	4 109.39	82.25	36.79	29.37	18.40
<b>HP 039</b>	2 70.66	53.20	25.77	20.57	14.67
	3 36.57	32.28	18.00	13.38	8.00
	4 26.57	23.27	12.46	8.80	5.58
<b>HP 050</b>	1 47.33	34.25	21.50	20.50	14.71
	2 29.10	25.95	14.04	10.90	5.88
	3 20.85	19.50	10.68	8.61	4.36
	4 14.55	12.90	7.32	6.90	3.69
	5 9.86	9.34	6.40	4.80	2.50
<b>HP 135</b>	1 29.16	25.33	13.00	12.47	5.92
	2 14.28	11.04	7.86	7.60	4.44
	3 8.96	7.46	4.89	4.16	3.07


Filter element	Absolute filtration N Series					Nominal filtration N Series
	A03	A06	A10	A16	A25	
Type	A03	A06	A10	A16	A25	M25
<b>HF 320</b>	1 3.65	2.95	2.80	1.80	0.90	0.38
	2 2.03	1.73	1.61	1.35	0.85	0.36
	3 1.84	1.42	1.32	1.22	0.80	0.35

# Selection Software FILTER SIZING

## Step ① Select "FILTERS"





## Step ② Choose filter group (Return Filter, Pressure Filter, etc.)

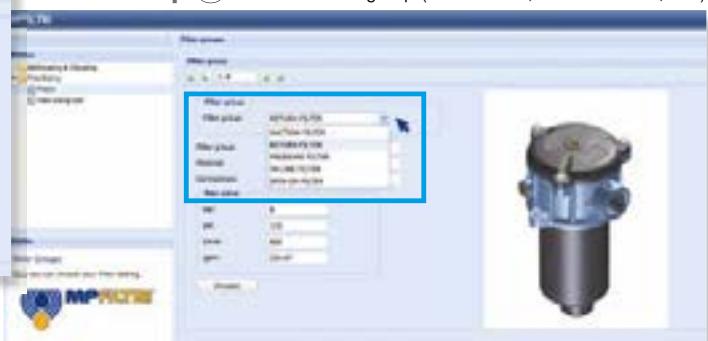

## Step ③ Choose filter type (MPF, MPT, etc.) in function of the max working pressure and the max flow rate




## Step ④ Push "PROCEED"

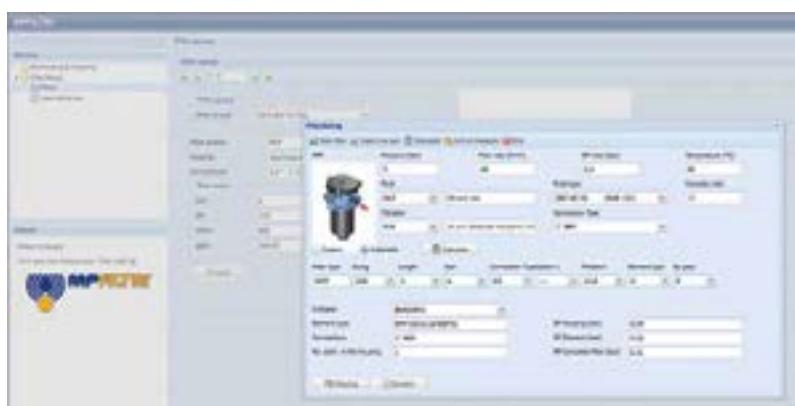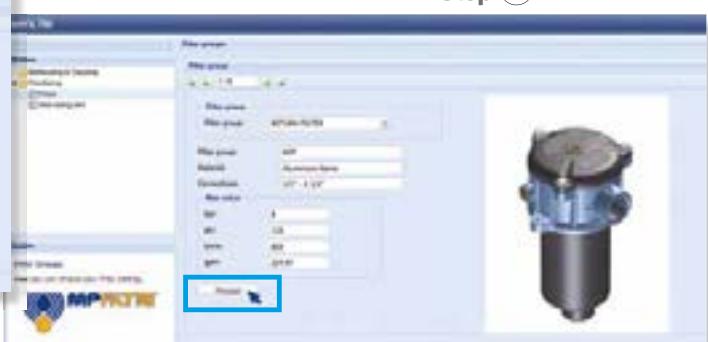

## Step ⑤

Insert all application data to calculate the filter size following the sequence:

- working pressure
- working flow rate
- working pressure drop
- working temperature
- fluid material and fluid type
- filtration media
- connection type

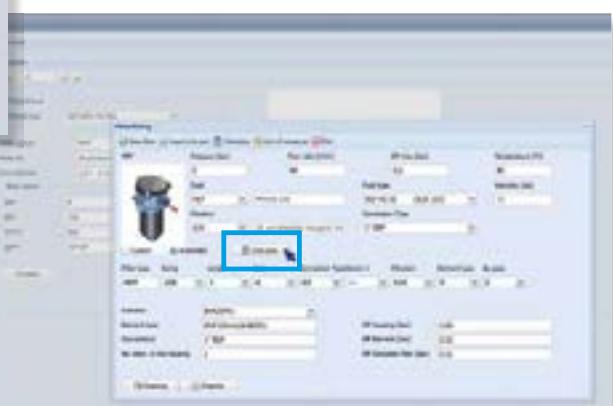

## Step ⑥

Push "CALCULATE" to have result;  
in case of any mistake, the system  
will advice which parameter is out  
of range to allow to modify/adjust  
the selection




## Step ⑦

Download PDF  
Datasheet "Report.aspx" pushing the button "Drawing"



THE NEW FILTER CONCEPT



## MRSX RSX series

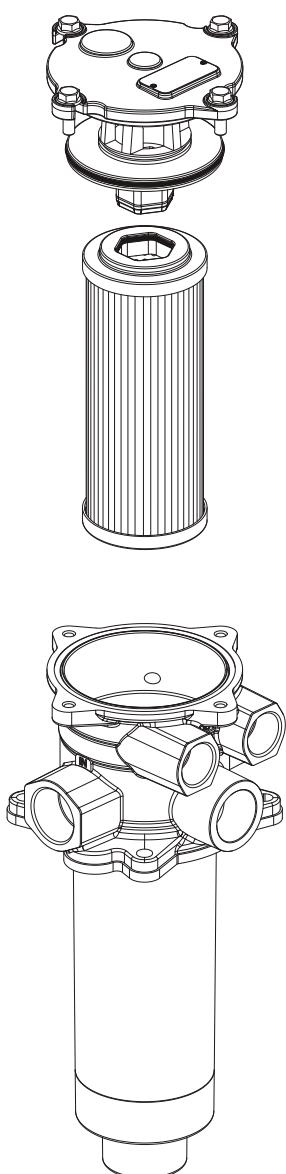

### NEW FILTER ELEMENT WITH EXCLUSIVE INTERFACE CONNECTION

- ◆ **Protects the machine from improper use of non-original products.**
- ◆ **Safety of constant quality protection & reliability**

With exclusive filter element you are sure that only filter elements MP Filtri can be used, ensuring the best cleaning level of the oil due to the use of originals filter elements.

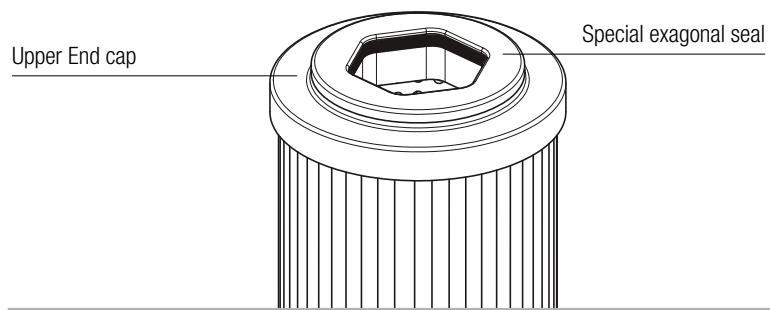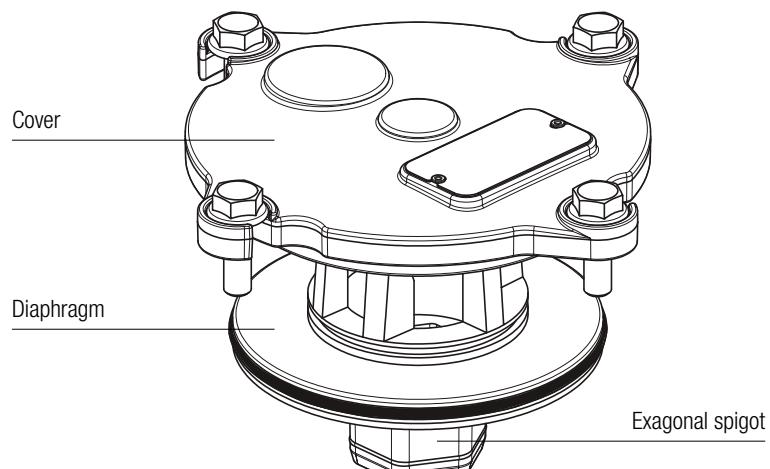


The products identified as MRSX and RSX are protected by one or more of the following patent applications:

European Patent Pending: n° 16181725.9  
Italian Patent Pending: n° 102015000040473  
US Patent Pending: n° 15/224,337  
Canadian Patent Pending: n° 2,937,258



# MRSX series

Maximum pressure up to 10 bar - Flow rate up to 300 l/min

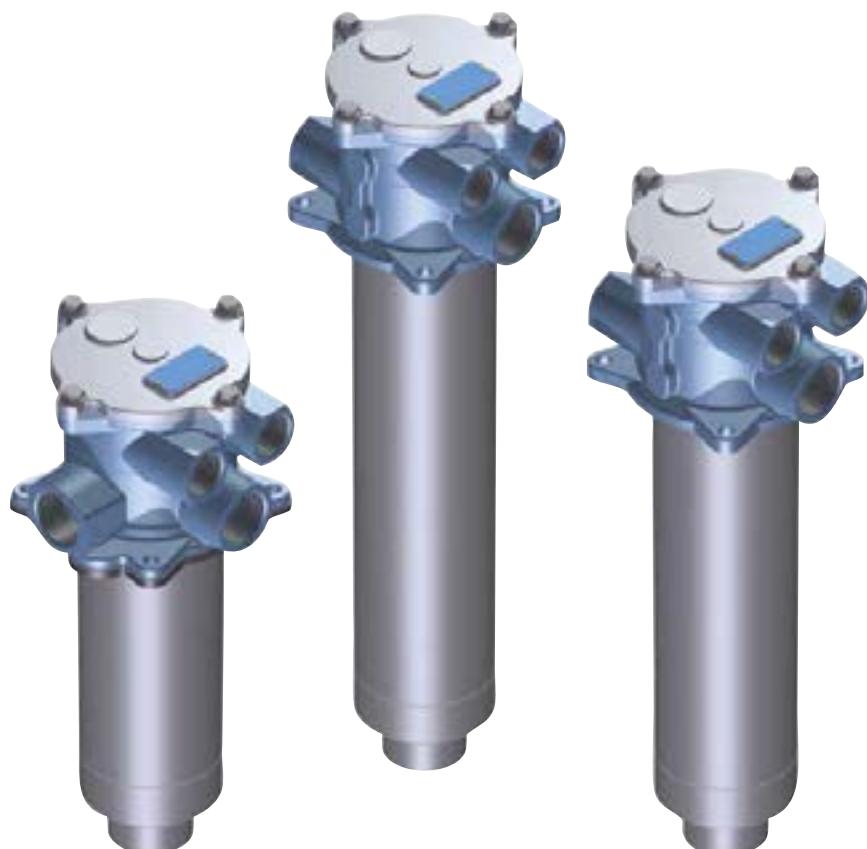

# MRSX GENERAL INFORMATION

## Technical data

**Return / Suction filter**  
Tank mounted

**Maximum pressure up to 10 bar - Flow rate up to 300 l/min**

### Filter housing materials

- Head: Aluminium
- Cover: Nylon (MRSX 116)
- Aluminium (MRSX 165-166)
- Bowl: Nylon

### Seals

- Standard NBR series A
- Optional FPM series V

### Pressure

Working pressure: 1 MPa (10 bar)

### Temperature

From -25 °C to +110 °C

### Δp element type

- RSX: 10 bar
- Oil flow from exterior to interior.

## Weights [kg] and volumes [dm<sup>3</sup>]

	Weights [kg]			Volumes [dm <sup>3</sup> ]				
	Length	1	2	3	Length	1	2	3
<b>MRSX 116</b>	Length	1.30	1.40	-	Length	0.80	1.00	-
<b>MRSX 165</b>		3.40	3.80	4.10		2.00	2.60	3.00
<b>MRSX 166</b>		3.40	3.80	4.10		2.00	2.60	3.00


## Hydraulic symbols

### MRSX 116


#### LEGEND

- 1 - Filter element
- 2 - Back-Pressure valve:  
opening pressure  
0.5 bar ±10%
- 3 - Bypass valve: opening  
pressure 2.5 bar ±10%
- 4 - Depressurization valve
- 5 - Anti-Cavitation valve
- 6 - Safety filter element  
(wire mesh 60 µm)
- 7 - Anti-Cavitation valve /  
Anti-Emptying valve


#### Valves "A" option

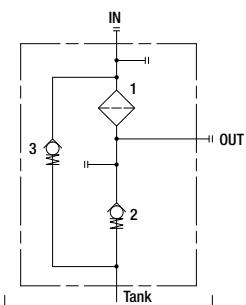


#### Valves "B" option

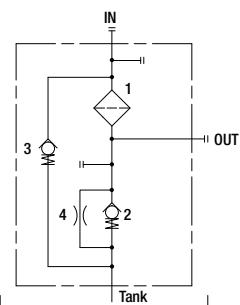


#### Valves "C" option

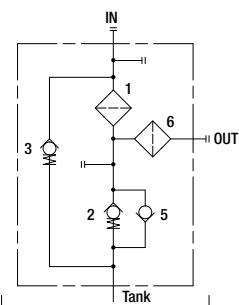


#### Valves "D" option

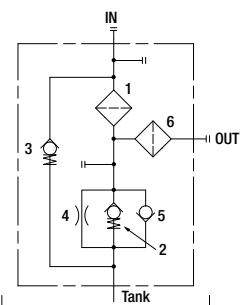


#### Valves "E" option

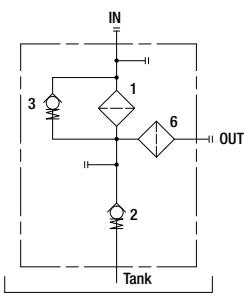


#### Valves "F" option

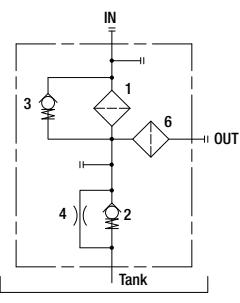

#### Valves "G" option

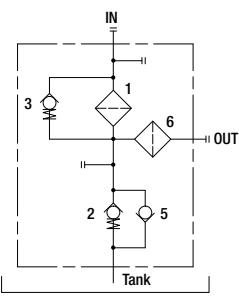


#### Valves "H" option

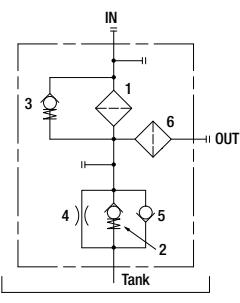


## Suitable only for tank side-wall mounting


#### Valves "I" option

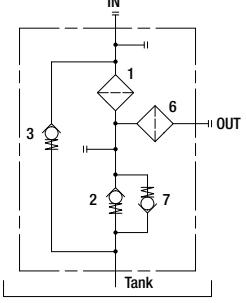


#### Valves "L" option

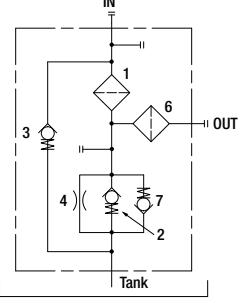

#### Valves "M" option





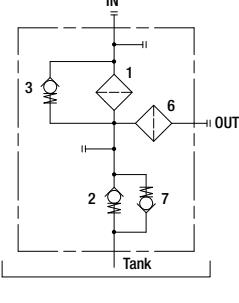


#### Valves "N" option


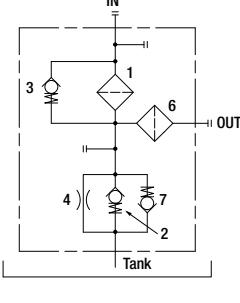


The curves are plotted using mineral oil with density of 0.86 kg/dm<sup>3</sup> in compliance with ISO 3968.

**Δp varies proportionally with density.**

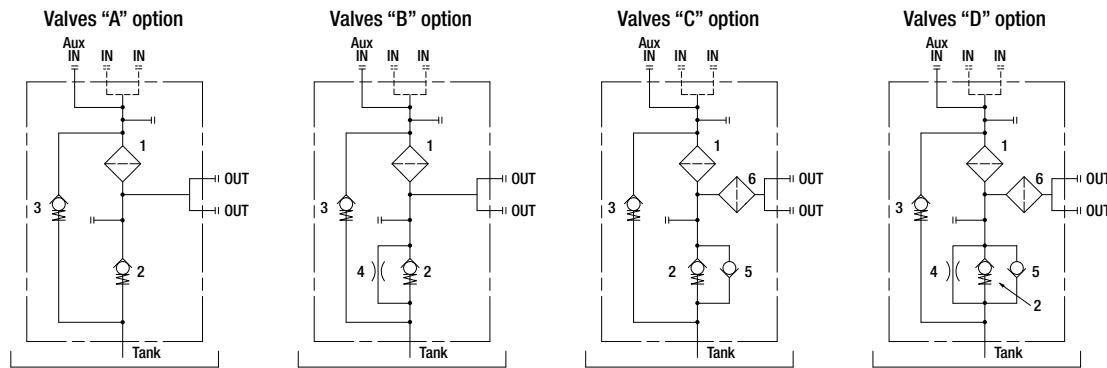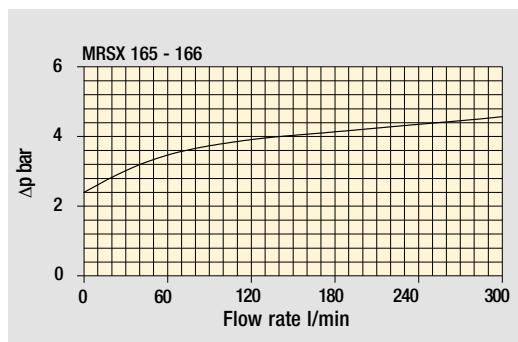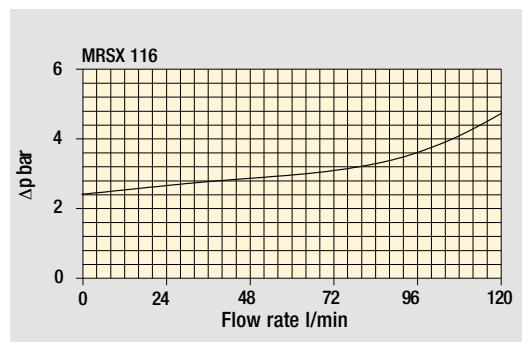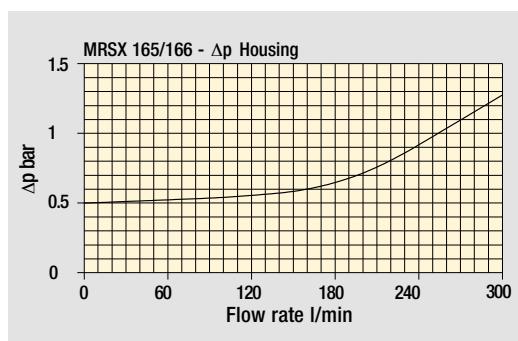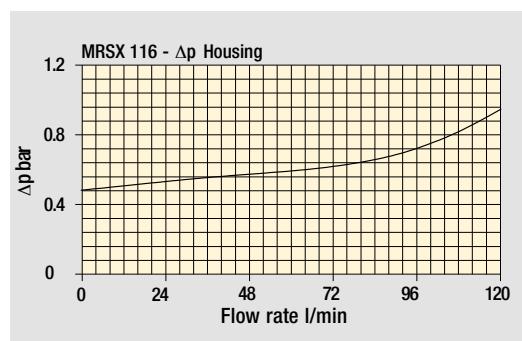

Hydraulic symbols  
MRSX 165 - 166

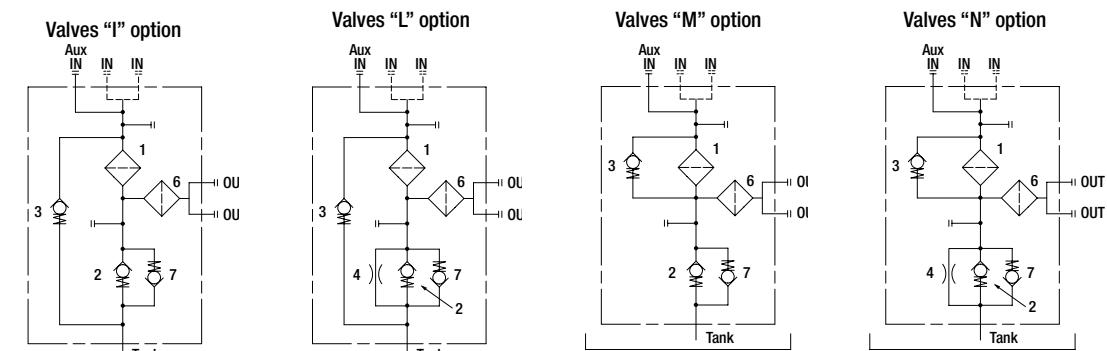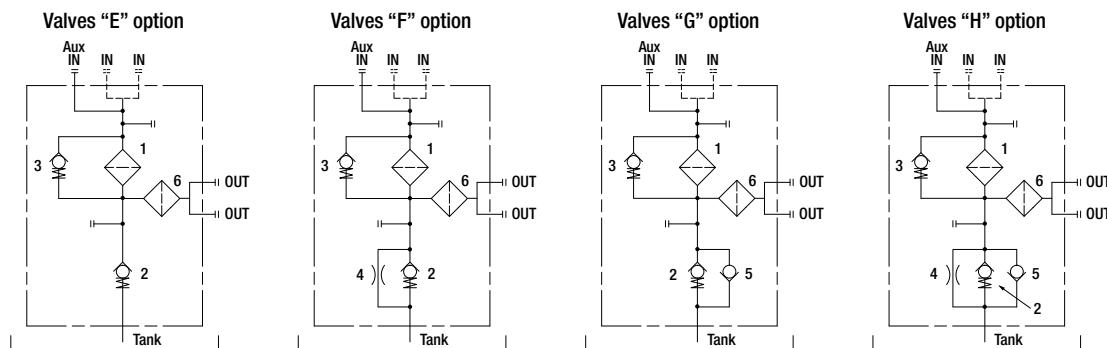

Suitable only for tank side-wall mounting

# MRSX MRSX116

## Designation & Ordering code

COMPLETE FILTER												
Series and size				Configuration example: MRSX116 1 B A G1 0 A16 B P01								
<b>MRSX116</b> Filter element with private spigot												
Length				1   2								
Hydraulic diagram configuration - see page 000				Bypass valve to tank	Bypass valve to OUT							
A   B   C   D	•											
E   F   G   H				•								
I   L	•											
M   N				•								
Seals and treatments												
A NBR, O-Ring on head	B NBR, flat seal on head											
V FPM, O-Ring on head	D FPM, flat seal on head											
Connections IN		Connections OUT										
G1 G3/4"	G3/4"											
G2 G1"	G1"											
G3 3/4" NPT	3/4" NPT											
G4 1" NPT	1" NPT											
G5 SAE 12 - 1 1/16" - 12 UN	SAE 12 - 1 1/16" - 12 UN											
G6 SAE 16 - 1 5/16" - 12 UN	SAE 16 - 1 5/16" - 12 UN											
D1 G1"	G3/4"											
D2 1" NPT	3/4" NPT											
D3 SAE 16 - 1 5/16" - 12 UN	SAE 12 - 1 1/16" - 12 UN											
Aux IN connection												
0 Without aux IN connection												
Filtration rating (filter media)												
A10 Inorganic microfiber 10 µm												
A16 Inorganic microfiber 16 µm												
A25 Inorganic microfiber 25 µm												
Valves configuration												
Mounting position	A   B   C   D   E   F   G   H   I   L   M   N											
S Standard	• • • • • • • •											
B Tank side-wall mounting	• • • • • • • •											
Execution												
P01 MP Filtri standard												
Pxx Customized												



FILTER ELEMENT											
Element series and size				Configuration example: RSX116 1 A16 A P01							
<b>RSX116</b> Filter element with private spigot											
Element length				1   2							
Filtration rating (filter media)											
A10 Inorganic microfiber 10 µm											
A16 Inorganic microfiber 16 µm											
A25 Inorganic microfiber 25 µm											
Seals											
A NBR											
V FPM											
Execution											
P01 MP Filtri standard											
Pxx Customized											

## ACCESSORIES




Indicators on Return Line	page	Indicators on Suction Line	page
BVA Axial pressure gauge	250	VEB Electrical pressure indicator	248
BVR Radial pressure gauge	250	BEM Electrical pressure indicator	248
BVP Visual pressure indicator with automatic reset	251	BET Electrical pressure indicator	248-249
BVQ Visual pressure indicator with manual reset	251	BLA Electrical / visual pressure indicator	249-250
Indicators on Suction Line	page	VEB Electrical vacuum indicator	245
VVB Axial vacuum gauge	247	VLB Electrical / visual vacuum indicator	245
VVS Radial vacuum gauge	247		

MRSX116		
Filter length	H1 [mm]	H2 [mm]
1	203	240
2	263	300

Connections	T
G1 - G2	G1/8"
G3 - G4	1/8" NPT
G5 - G6	1/8" NPT
D1	G1/8"
D2 - D3	1/8" NPT

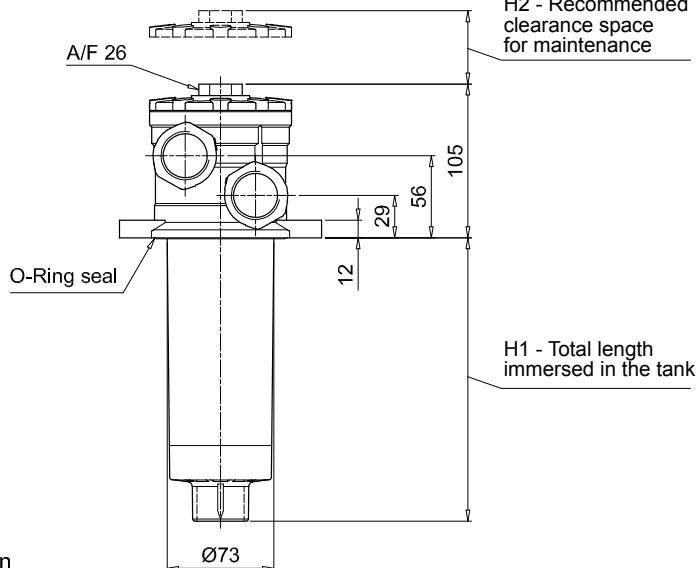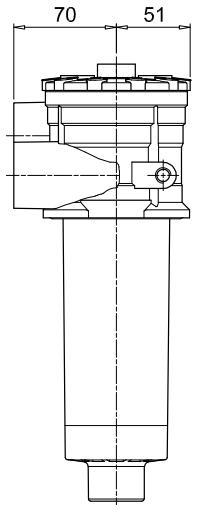

Return ↓ Suction ↑

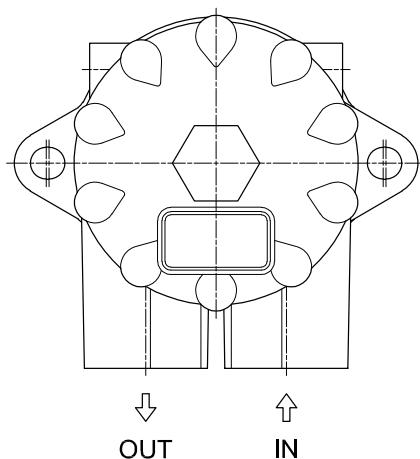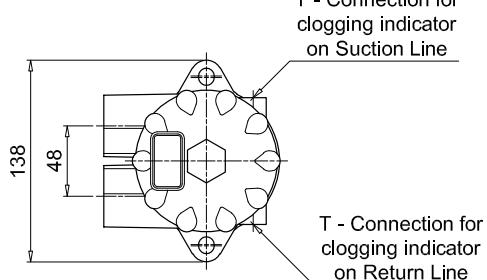

# MRSX MRSX165 - MRSX166

## Designation & Ordering code




COMPLETE FILTER												
Series and size				Configuration example: MRSX166 2 C V G3 1 A10 S P01								
<b>MRSX165   MRSX166</b> Filter element with private spigot												
Length				1   2   3								
Hydraulic diagram configuration - see page 000				Bypass valve to tank	Bypass valve to OUT							
A	B	C	D	•								
E	F	G	H	•								
I	L	•										
M	N	•										
Seals and treatments												
<b>A</b>	NBR, O-Ring on head			<b>B</b>	NBR, flat seal on head			<b>C</b>				
<b>V</b>	FPM, O-Ring on head			<b>D</b>	FPM, flat seal on head			<b>E</b>				
Connections												
IN (size 165)		IN (size 166)		Aux IN		OUT						
<b>G1</b>	G1 1/4"		<b>G1</b> "	G1 1/4"		G1"						
<b>G2</b>	1 1/4" NPT		1" NPT	1 1/4" NPT		1" NPT						
<b>G3</b>	SAE 20 - 1 5/8" - 12 UN		SAE 16 - 1 5/16" - 12 UN	SAE 20 - 1 5/8" - 12 UN		SAE 16 - 1 5/16" - 12 UN						
Aux IN connection				MRS 165   MRS 166								
<b>0</b>	Without aux IN connection			• -								
<b>1</b>	With aux IN connection - see previous table			• •								
Filtration rating (filter media)												
<b>A10</b>	Inorganic microfiber 10 µm											
<b>A16</b>	Inorganic microfiber 16 µm											
<b>A25</b>	Inorganic microfiber 25 µm											
Valves configuration												
Mounting position	<b>A</b>	<b>B</b>	<b>C</b>	<b>D</b>	<b>E</b>	<b>F</b>	<b>G</b>	<b>H</b>	<b>I</b>	<b>L</b>	<b>M</b>	<b>N</b>
<b>S</b> Standard	•	•	•	•	•	•	•	•	•			
<b>B</b> Tank side-wall mounting	•	•			•	•			•	•	•	•
Execution												
<b>P01</b> MP Filtri standard												
<b>Pxx</b> Customized												

FILTER ELEMENT											
Element series and size				Configuration example: RSX165 2 A10 V P01							
<b>RSX165</b> Filter element with private spigot											
Element length				1   2   3							
Filtration rating (filter media)											
<b>A10</b>	Inorganic microfiber 10 µm										
<b>A16</b>	Inorganic microfiber 16 µm										
<b>A25</b>	Inorganic microfiber 25 µm										
Seals											
<b>A</b>	NBR			<b>V</b>	FPM			<b>E</b>			
Execution											
<b>P01</b> MP Filtri standard											
<b>Pxx</b> Customized											

## ACCESSORIES


Indicators on Return Line	page	Indicators on Suction Line	page
<b>BVA</b> Axial pressure gauge	250	<b>VEB</b> Electrical pressure indicator	248
<b>BVR</b> Radial pressure gauge	250	<b>BEM</b> Electrical pressure indicator	248
<b>BVP</b> Visual pressure indicator with automatic reset	251	<b>BET</b> Electrical pressure indicator	248-249
<b>BVQ</b> Visual pressure indicator with manual reset	251	<b>BLA</b> Electrical / visual pressure indicator	249-250
<b>Indicators on Suction Line</b>	<b>page</b>	<b>VEB</b> Electrical vacuum indicator	245
<b>VVB</b> Axial vacuum gauge	247	<b>VLB</b> Electrical / visual vacuum indicator	245
<b>VVS</b> Radial vacuum gauge	247		


MRSX165		
Filter length	H1 [mm]	H2 [mm]
1	270	320
2	378	430
3	445	500
Connections	T	
G1	G1/8"	
G2 - G3	1/8" NPT	

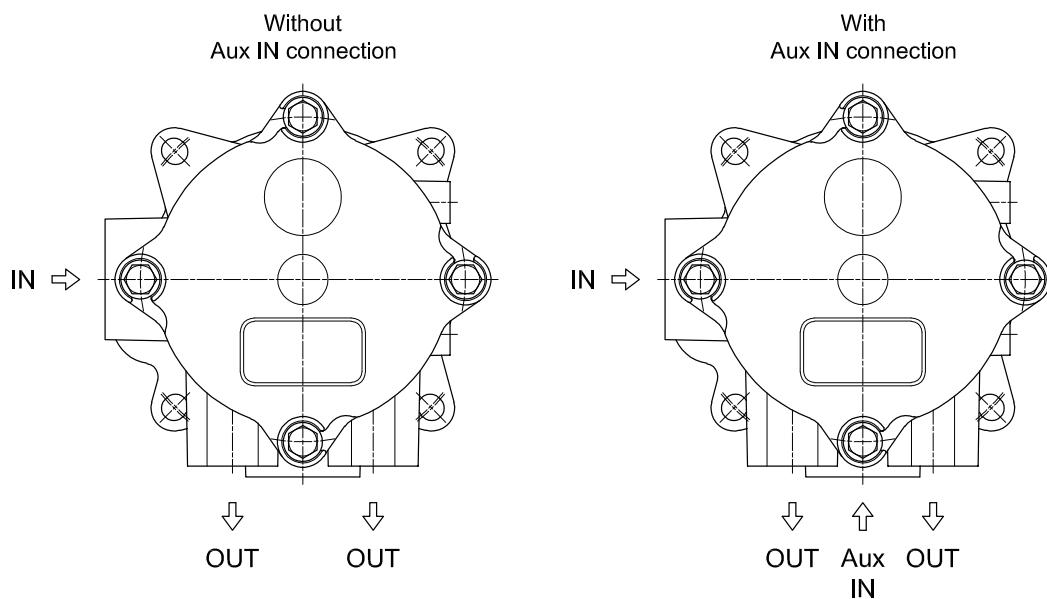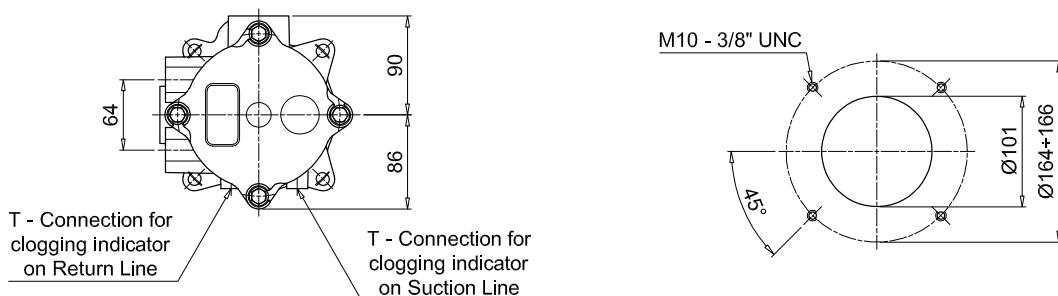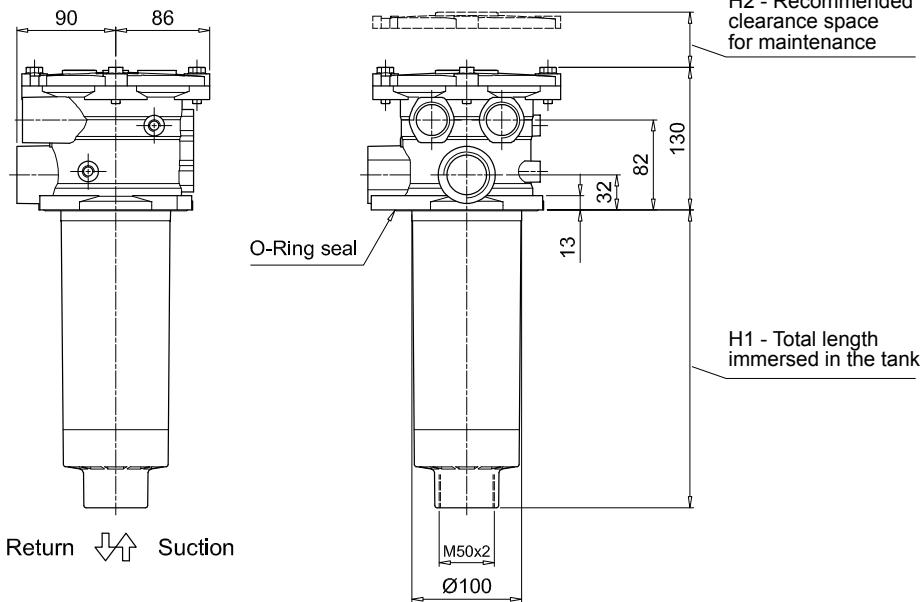


# MRSX MRSX165 - MRSX166

## Dimensions

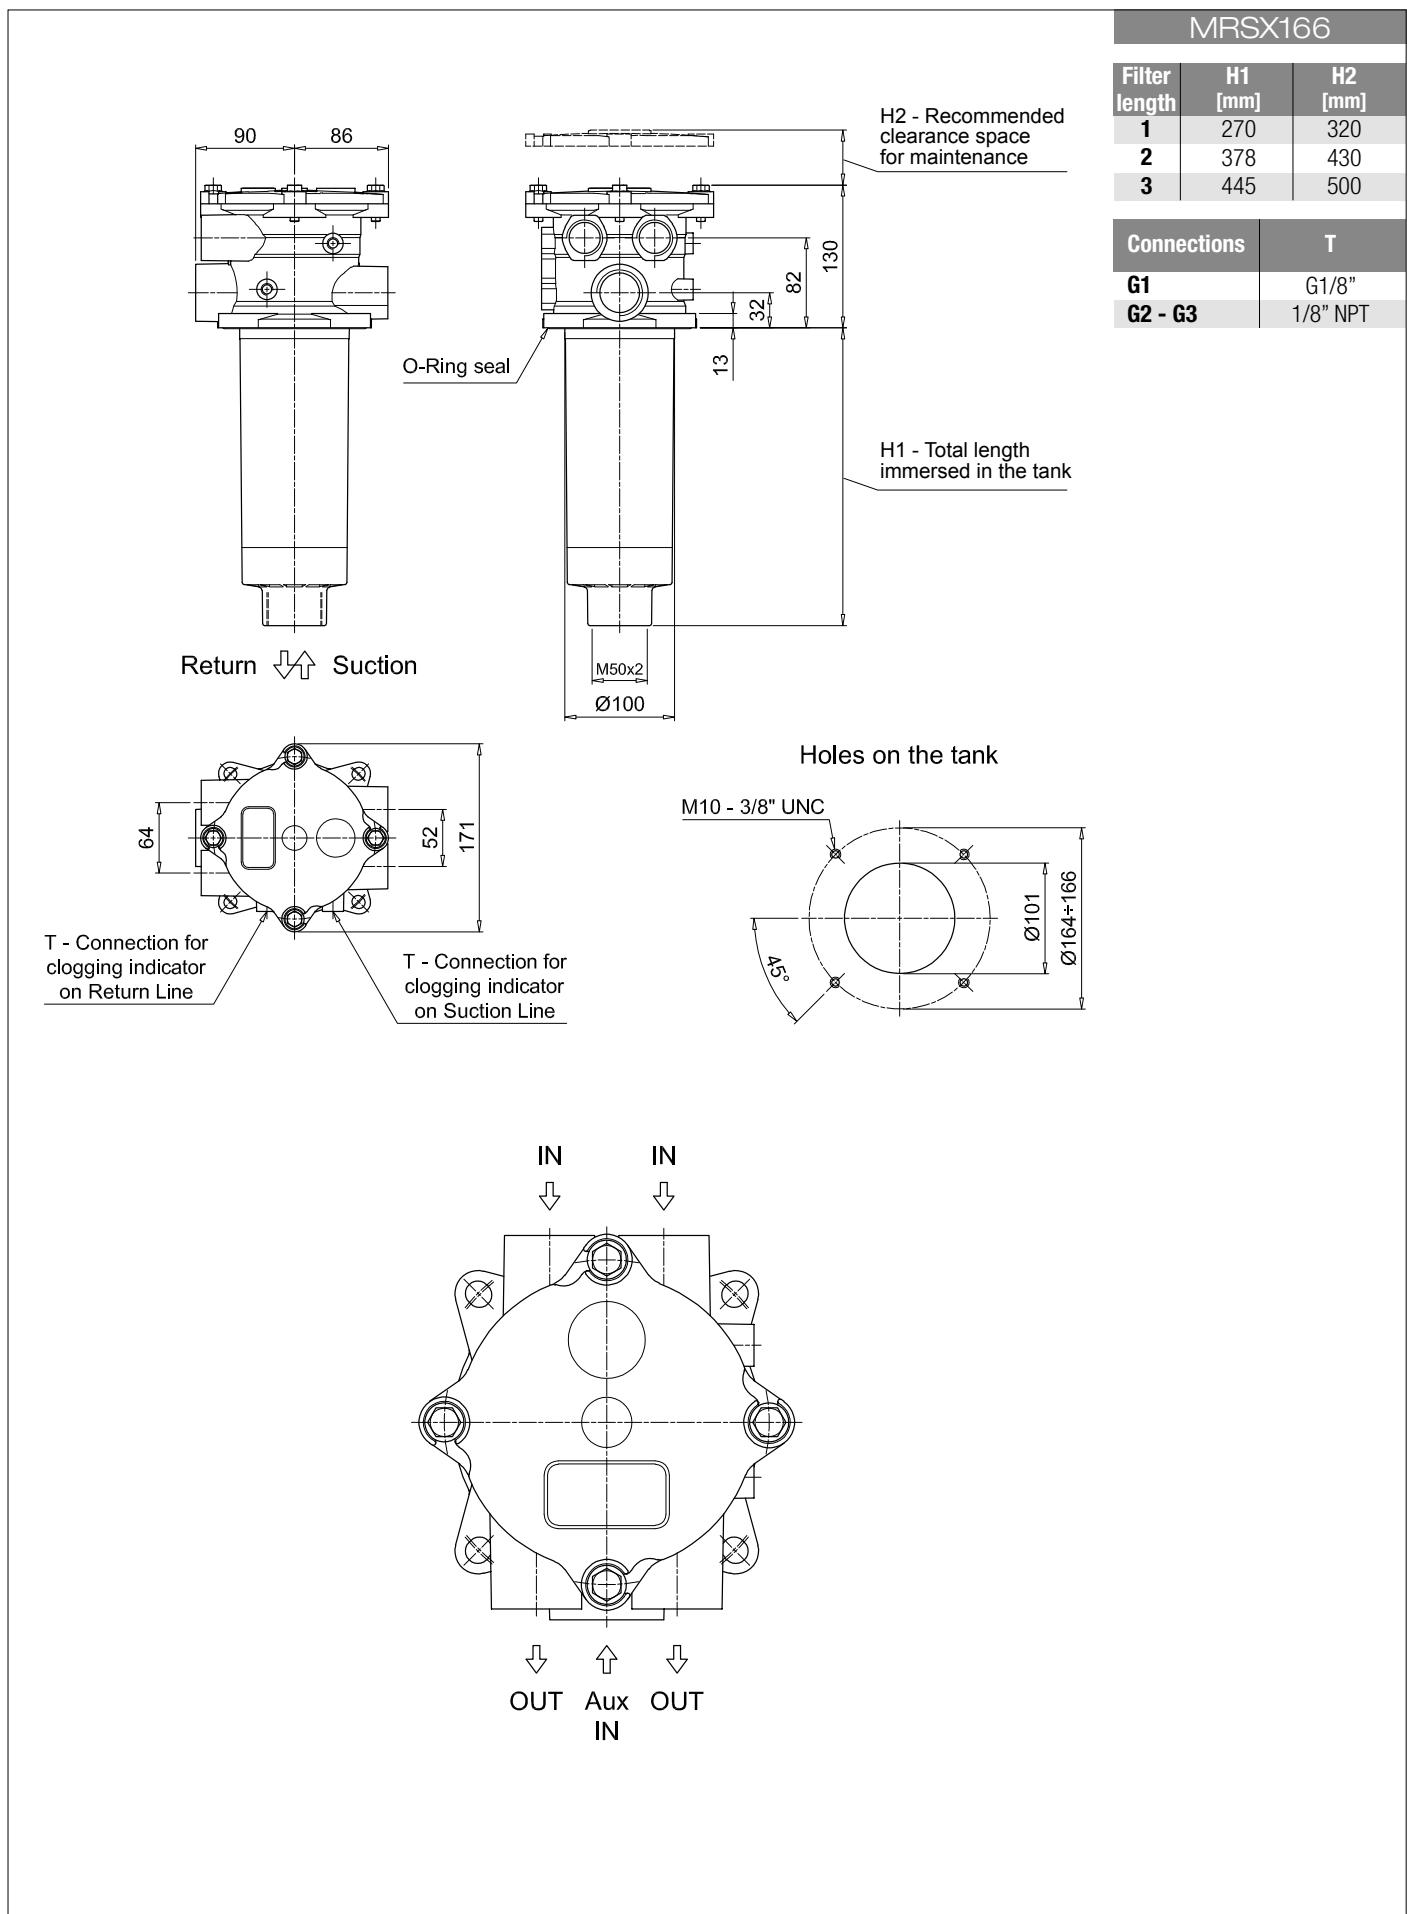

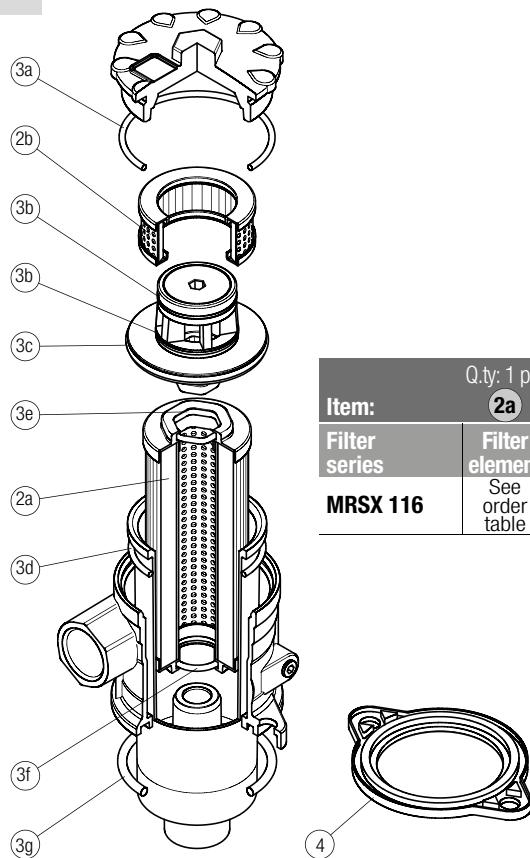**MRSX 116**

Item: Filter series	Q.ty: 1 pc. 2a	Q.ty: 1 pc. 2b	Q.ty: 1 pc. 3 (3a ÷ 3g)		Q.ty: 1 pc. 4	
	Filter element See order table	Safety filter element S116M60P01	Seal Kit code number NBR FPM	Optional head seal (molded gasket) NBR FPM	NBR FPM	
<b>MRSX 116</b>			02050617 02050619	01026593	01026598	

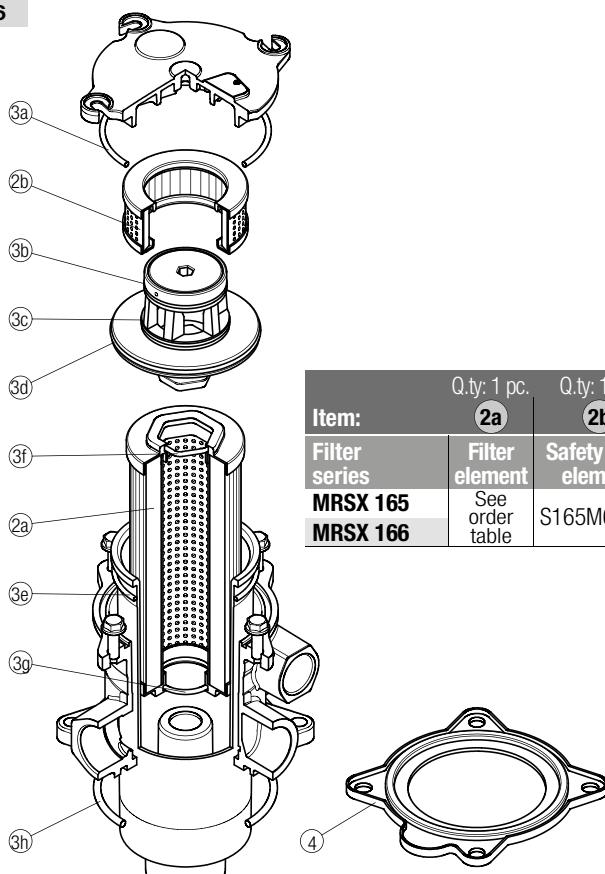**MRSX 165 - 166**

Item: Filter series	Q.ty: 1 pc. 2a	Q.ty: 1 pc. 2b	Q.ty: 1 pc. 3 (3a ÷ 3h)		Q.ty: 1 pc. 4	
	Filter element See order table	Safety filter element S165M60P01	Seal Kit code number NBR FPM	Optional head seal (molded gasket) NBR FPM	NBR FPM	
<b>MRSX 165</b>			02050627 02050630	01026621	01026622	
<b>MRSX 166</b>			02050627 02050630	01026626	01026627	